



DRAWING CHANGES				
REV	ECN NO	DESCRIPTION	BY	CKD
DATE				

TANK WEIGHT: DRY WEIGHT:250L – 60kg 315L – 72kg WET WEIGHT:250L – 310kg 315L – 385kg	PRIMARY PUMP: DD4: 2xGRUNDFOFOS UPS32–100N HD210 HEATERS:	GENERAL NOTE: CONTROLLER REQUIRES: 1 X EXTERNAL GPO (10AMP) HEATERS REQUIRE: 1 X EXTERNAL GPO (10AMP) PER HEATER ** PLEASE NOTE ** DO NOT RUN CONDENSATE DRAIN IN COPPER. UPVC PIPE IS RECOMMENDED.
SYSTEM WEIGHT: DRY WEIGHT:250L – 228kg 315L – 240kg WET WEIGHT:250L – 478kg 315L – 553kg	SYSTEM GAS LOAD: 836MJ –NG 1.13–3.00 kPa –LPG 2.75–3.00 kPa THERMOSTAT: FACTORY SET AT 65° (HIGHER TEMP AVAILABLE)	

ELEVATION VIEW

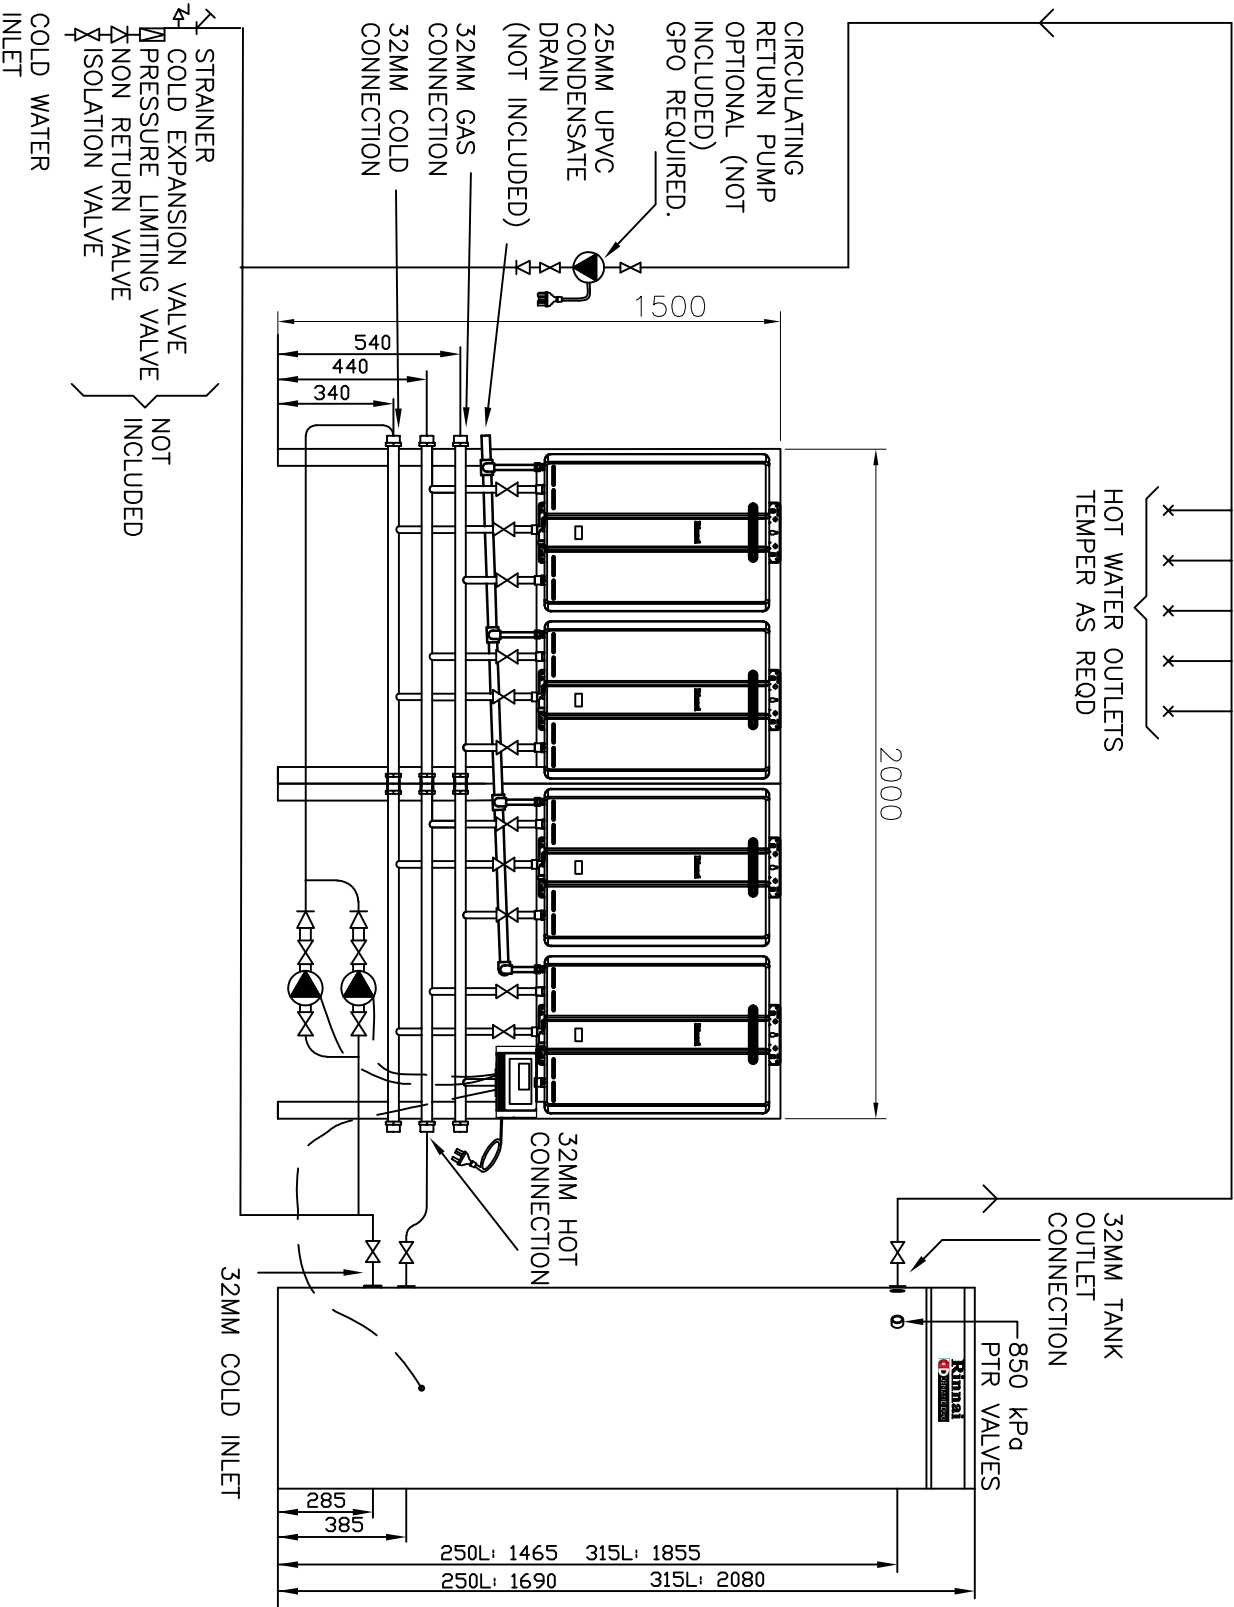

PLAN VIEW

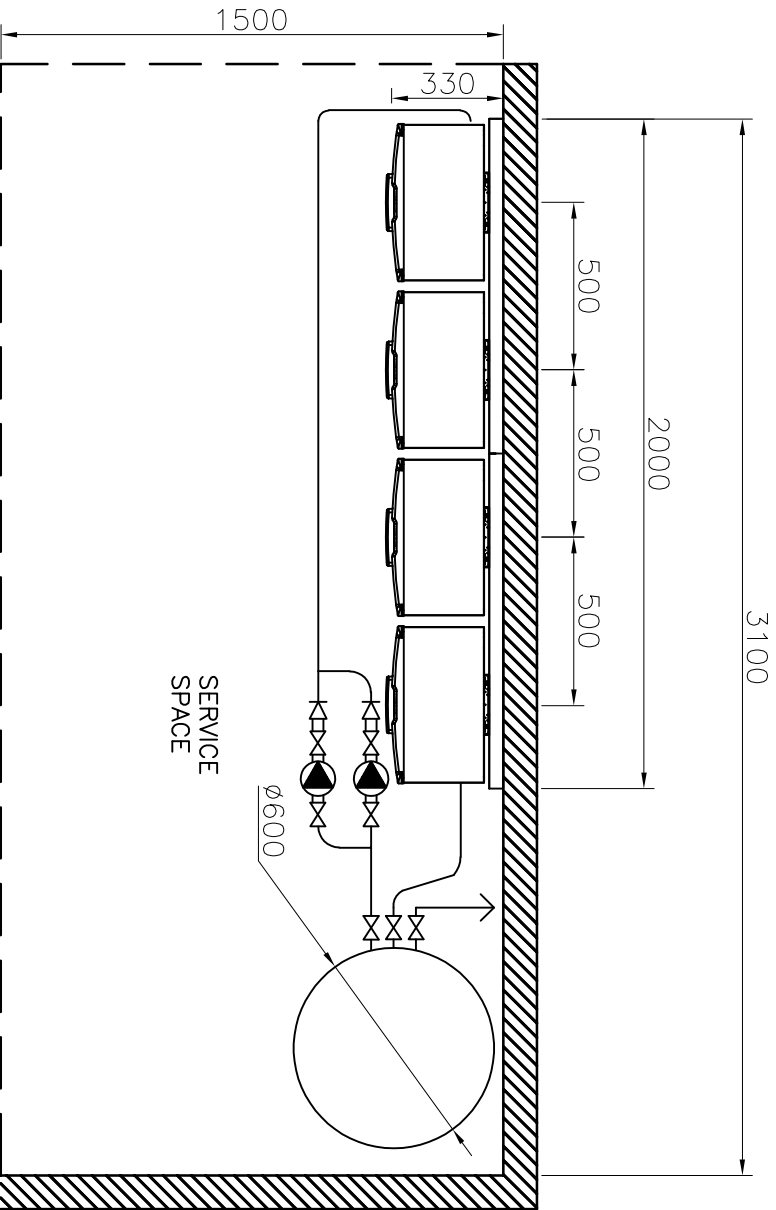

MATERIAL		DRAWN		RMP		Title Rinnai Australia Pty Ltd <	
----------	--	-------	--	-----	--	---	--