



ELEVATION VIEW

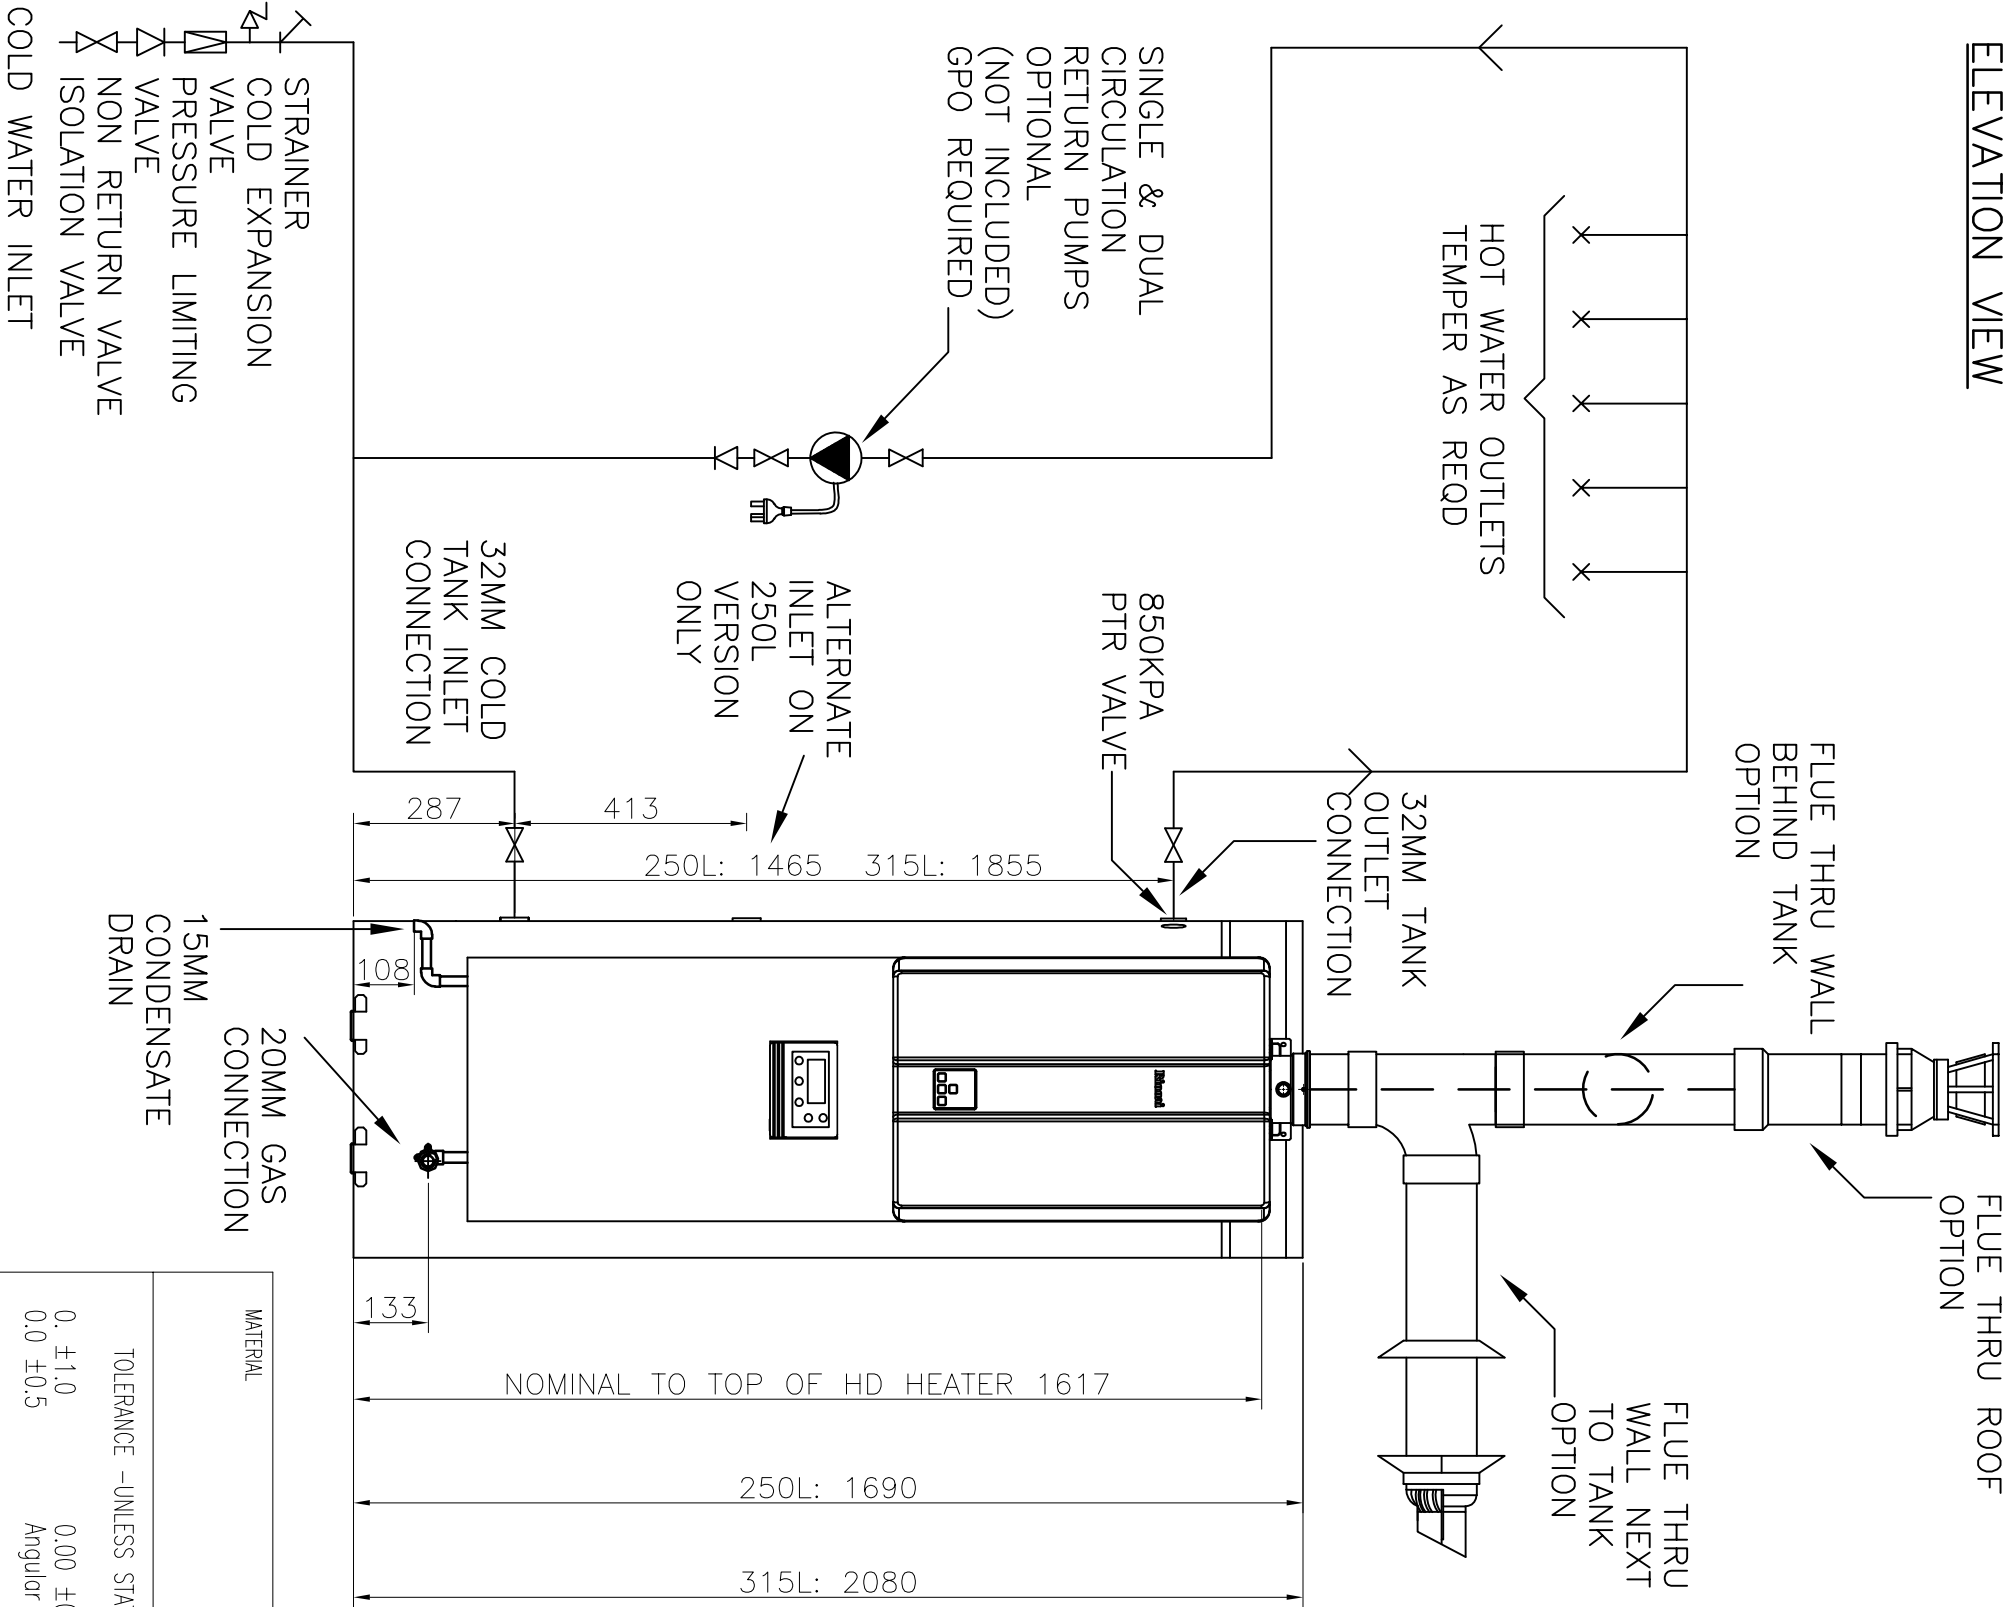

PLAN VIEW

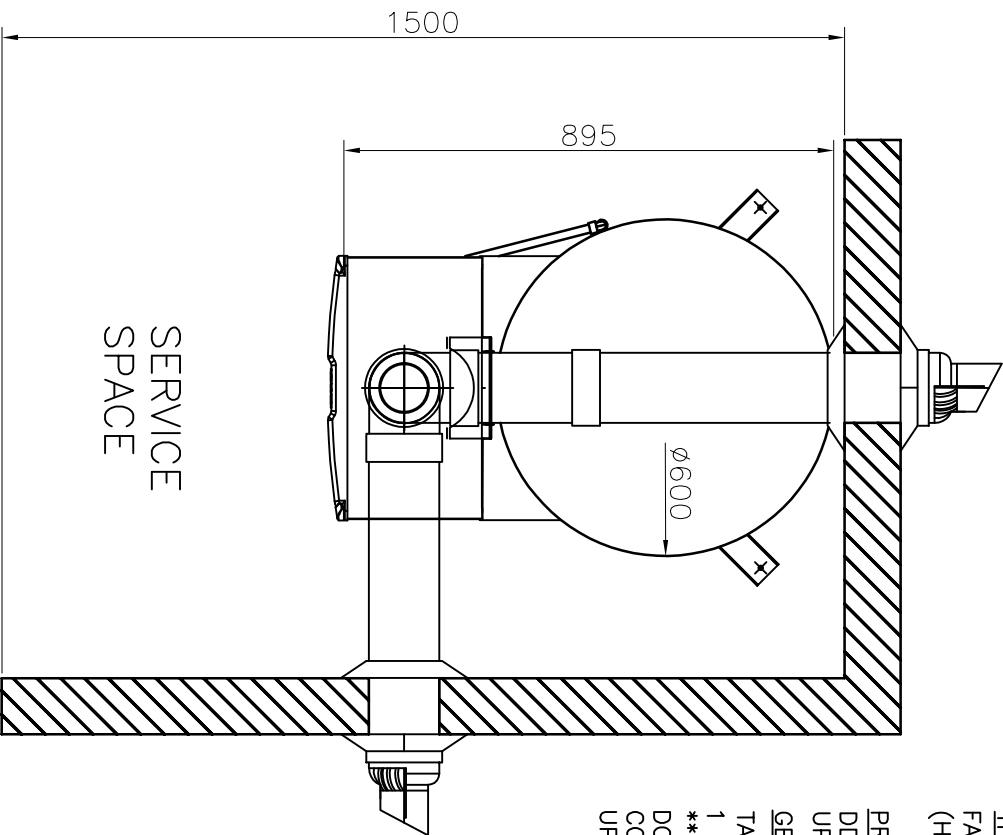

DRAWING CHANGES				
REV	ECN NO	DESCRIPTION	BY	CKD
DATE				

TANK:
SYSTEM:
DRY WEIGHT:250L – 91kg
315L – 105kg
WET WEIGHT:250L – 341kg
315L – 418kg
HD210 HEATER:
SYSTEM GAS LOAD 209MJ
-NG 1.13–3.00 kPa
-LPG 2.75–3.00kPa
FAN ASSISTED, BALANCED FLUE
THERMOSTAT:
FACTORY SET AT 65°
(HIGHER TEMP AVAILABLE)

PRIMARY PUMP:
DD1: 1xGRUNDFOS
UPS32–100N
GENERAL NOTE::
TANK REQUIRES:
1 X EXTERNAL GPO (10AMP)
** PLEASE NOTE **
DO NOT RUN
CONDENSATE DRAIN IN COPPER.
UPVC PIPE IS RECOMMENDED.

MATERIAL		DRAWN		RMP		Title Rinnai Australia Pty Ltd 	
----------	--	-------	--	-----	--	--	--

Rinnai Australia Pty Ltd