


| DRAWING CHANGES | | | | | |
|---|---|---|---|---|---|
| REV | ECN NO | DESCRIPTION | BY | CKD | DATE |
| | | | | | |

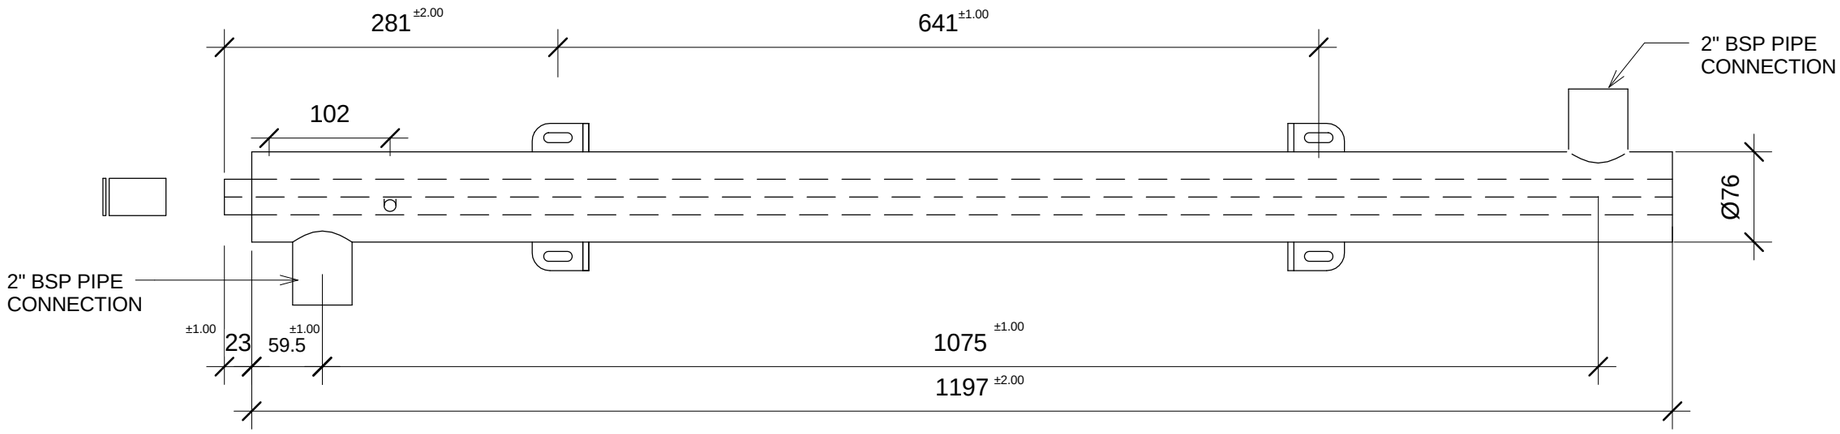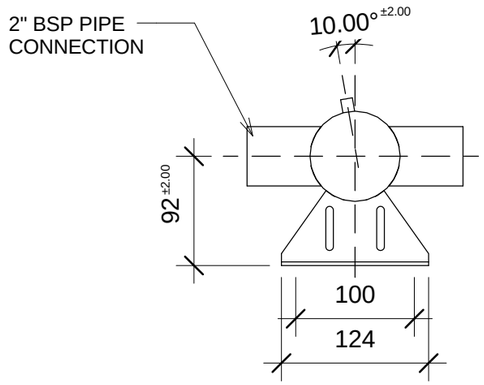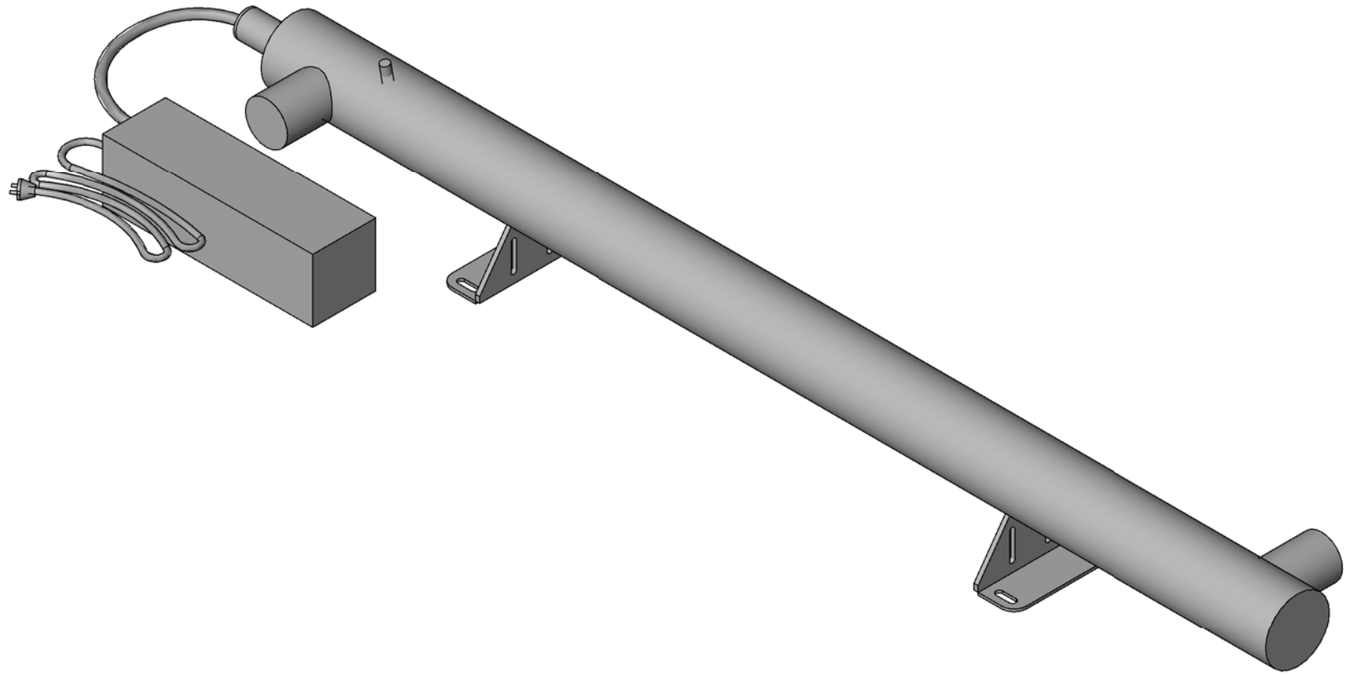

DDUV300 - UV steriliser notes

| | |
|---|---|
| Max flow rate | - 300 l/min |
| Power supply | - AC 240 V 50 Hz |
| Max operating pressure | - 1000 kPa |
| Inlet | - R2” (50mm) |
| Outlet | - R2” (50mm) |

| | | | |
|---|---|---|---|
| MATERIAL | | DRAWN | DAP |
| TOLERANCE – UNLESS STATED<br>0.±1.0 0.00 ±0.1<br>0.0 ±0.5 Angular ±1 | DIMENSIONS ARE IN MILLIMITERS AS 1:100 THIRD ANGLE PROJECTION | DATE | 17/07/12 |
| | | CHECKED | SVL |
| | | APPROVED | |
| FINISH: | DO NOT SCALE DRAWING | | |

Rinnai Australia Pty Ltd

Title: DDUV300 - UV STERILISER

| Weight | Drawing Number(PART NO) | Revision |
|---|---|---|
| | RA-17-07-12-001 | |