


DRAWING CHANGES

REV	ECN NO	DESCRIPTION	BY	CKD	DATE

ELEVATION VIEW

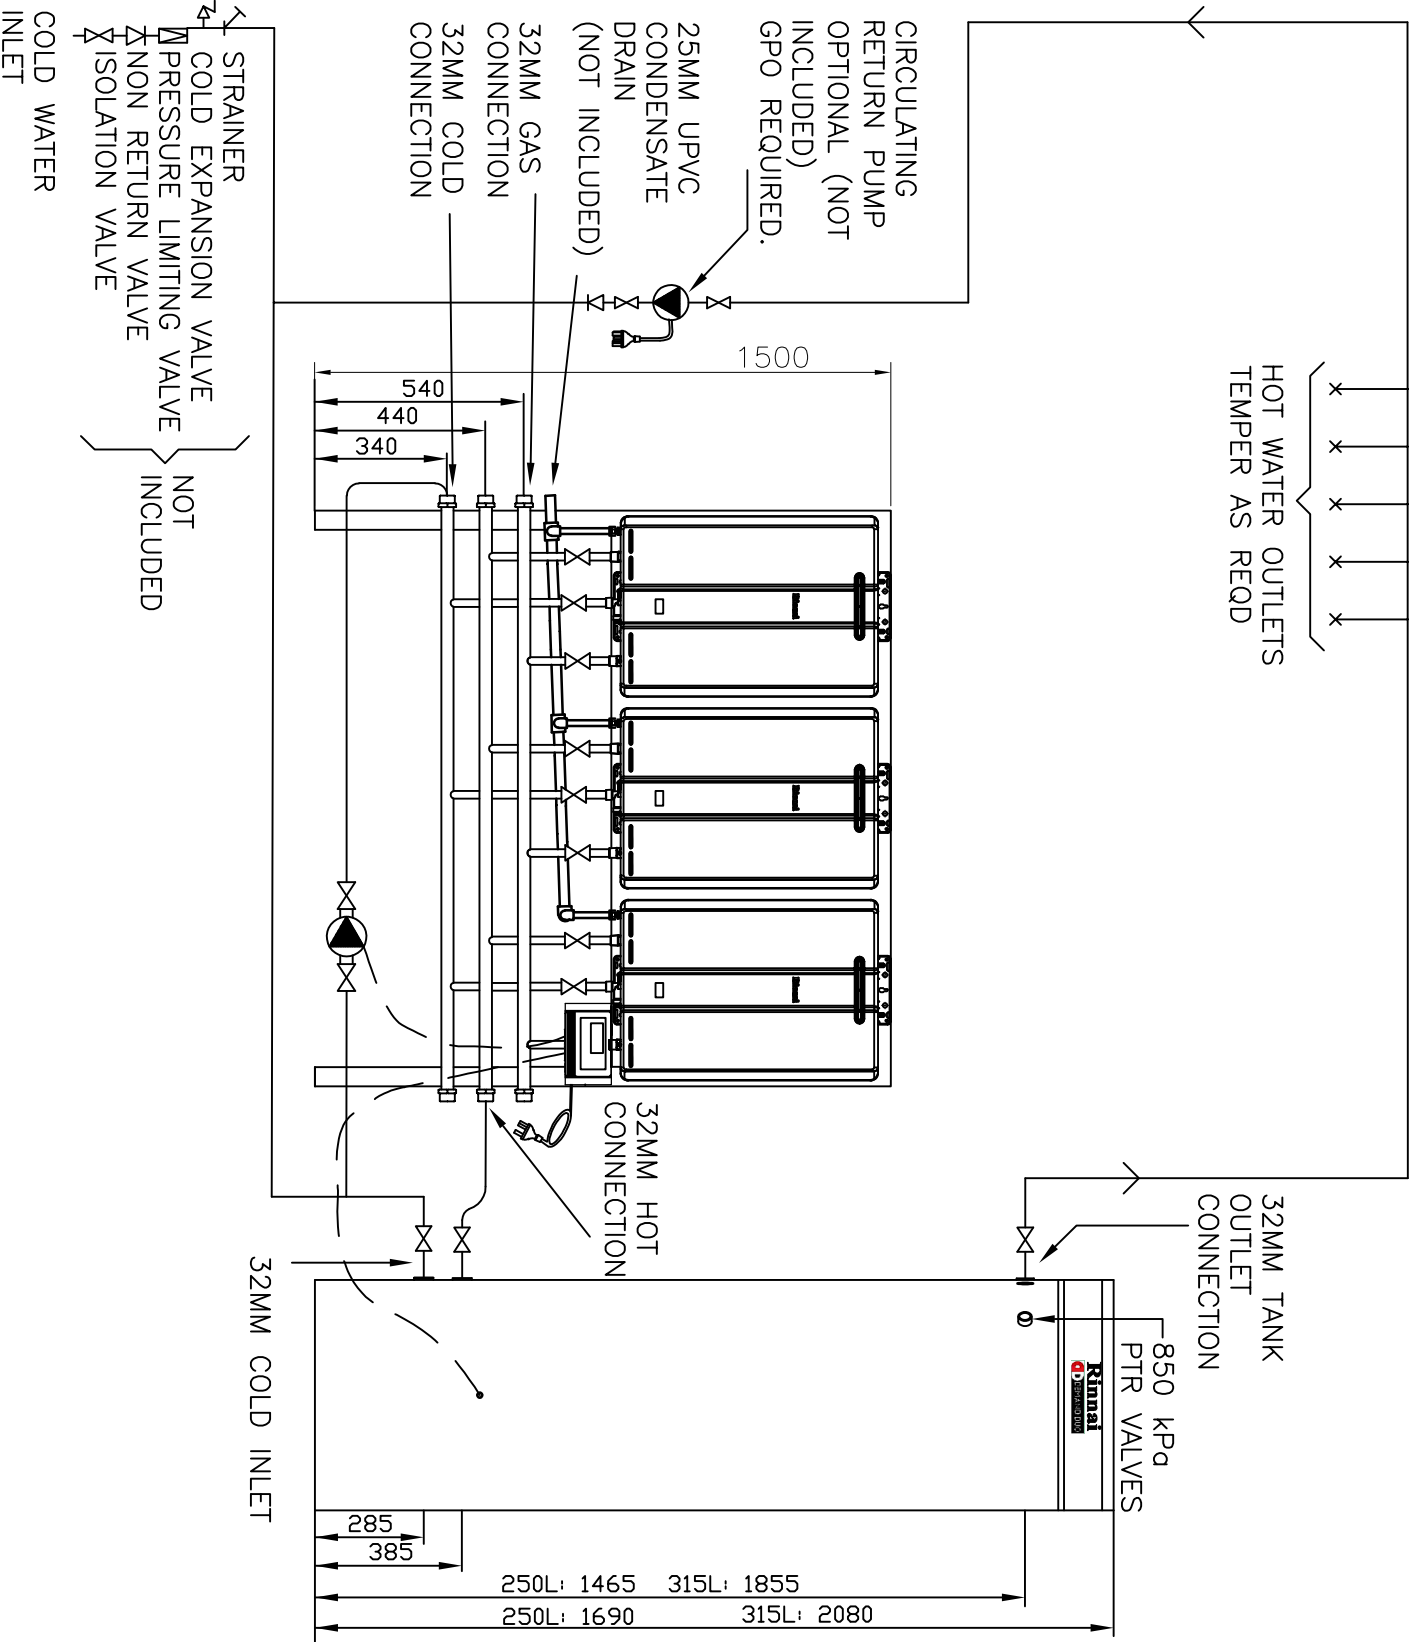

- TANK WEIGHT:**

 - DRY WEIGHT: 250L – 60kg
 - 315L – 72kg
 - WET WEIGHT: 250L – 310kg
 - 315L – 385kg
- SYSTEM WEIGHT:**

 - DRY WEIGHT: 250L – 183kg
 - 315L – 195kg
 - WET WEIGHT: 250L – 433kg
 - 315L – 508kg
- PRIMARY PUMP:**

 - DD3: 1xGRUNDFOS UPS32-100N
 - HD210 HEATERS:
- GENERAL NOTE:**


 - CONTROLLER REQUIRE: 1 X EXTERNAL GPO (10AMP)
 - HEATERS REQUIRE: 1 X EXTERNAL GPO (10AMP) PER HEATER
 - ** PLEASE NOTE **
 - DO NOT RUN CONDENSATE DRAIN IN COPPER.
 - UPVC PIPE IS RECOMMENDED.
 - (HIGHER TEMP AVAILABLE)
- SYSTEM GAS LOAD:** 627MJ

 - NG 1.13-3.00 kPa
 - LPG 2.75-3.00 kPa

THERMOSTAT:

 - FACTORY SET AT 65°
 - (HIGHER TEMP AVAILABLE)

PLAN VIEW

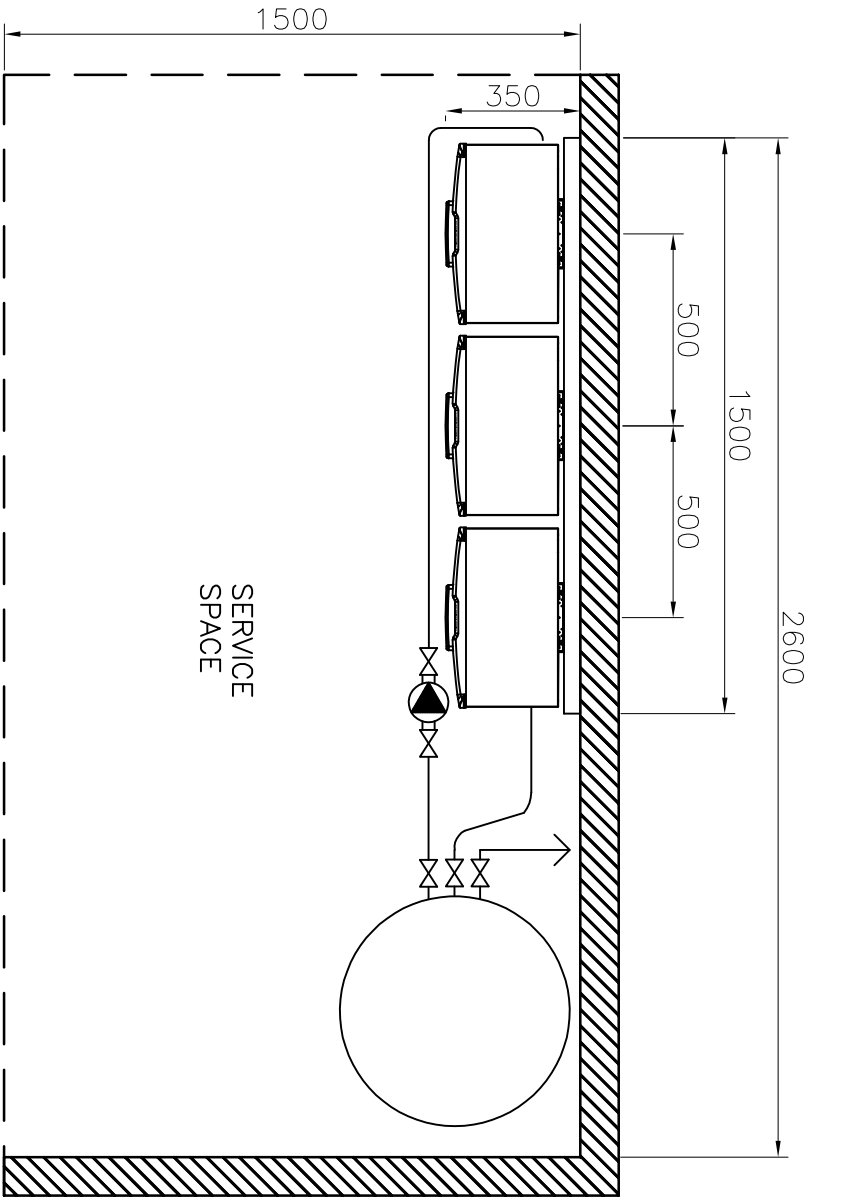

STRAINER
COLD EXPANSION VALVE
PRESSURE LIMITING VALVE
NON RETURN VALVE
ISOLATION VALVE
COLD WATER
INLET

NOT INCLUDED

MATERIAL		DRAWN	RMP	Title Rinnai Australia Pty Ltd DDF3210E-250/315N	
TOLERANCE -UNLESS STATED		DATE	30/03/20		
0. ±1.0 0.0 ±0.5		CHECKED	SVL		
FINISH:		APPROVED			
DIMENSIONS ARE IN MILLIMETERS AS 1100		THIRD ANGLE PROJECTION		Weight	Drawing Number(PART NO)
DO NOT SCALE DRAWING				SEE NOTES	SK 0158
					Revision
					1