



DRAWING CHANGES				
REV	ECN NO	DESCRIPTION	BY	CKD
DATE				

TANK WEIGHT: DRY WEIGHT:250L – 60kg 315L – 72kg WET WEIGHT:250L – 310kg 315L – 385kg	PRIMARY PUMP: DD6: 2xGRUNDFOFOS UPS32–100N HD210 HEATERS: SYSTEM GAS LOAD: 1254MJ –NG 1.13–3.00 kPa –LPG 2.75–3.00 kPa THERMOSTAT: FACTORY SET AT 65° (HIGHER TEMP AVAILABLE)	GENERAL NOTE: CONTROLLER REQUIRES: 1 X EXTERNAL GPO (10AMP) HEATERS REQUIRE: 1 X EXTERNAL GPO (10AMP) PER HEATER ** PLEASE NOTE ** DO NOT RUN CONDENSATE DRAIN IN COPPER. UPVC PIPE IS RECOMMENDED.
---	---	---

ELEVATION VIEW

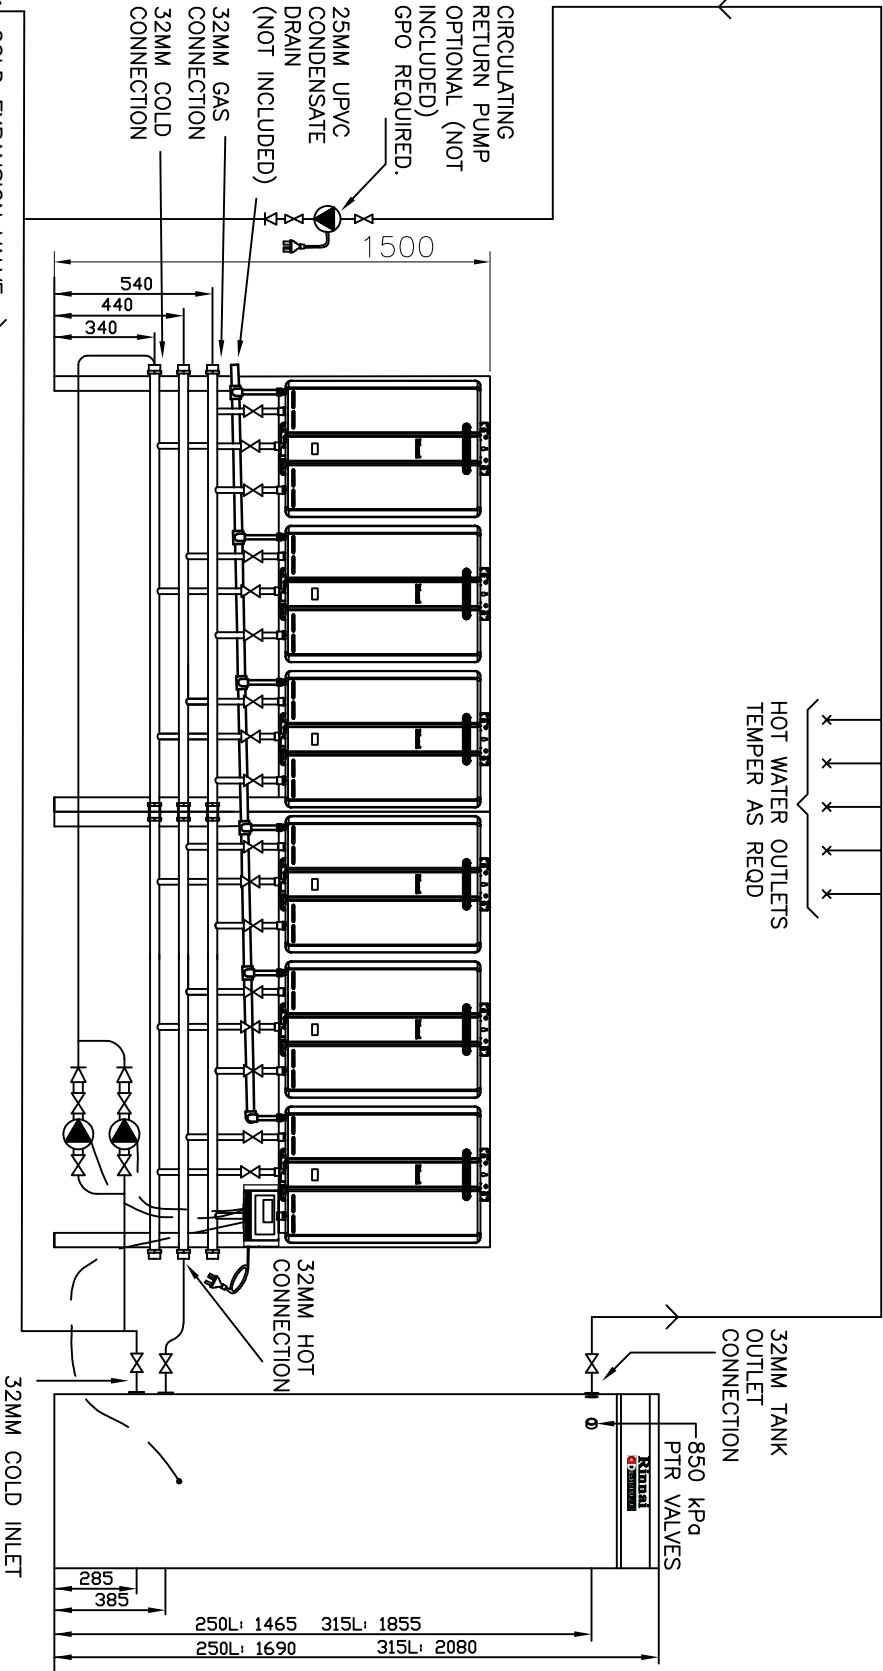

PLAN VIEW

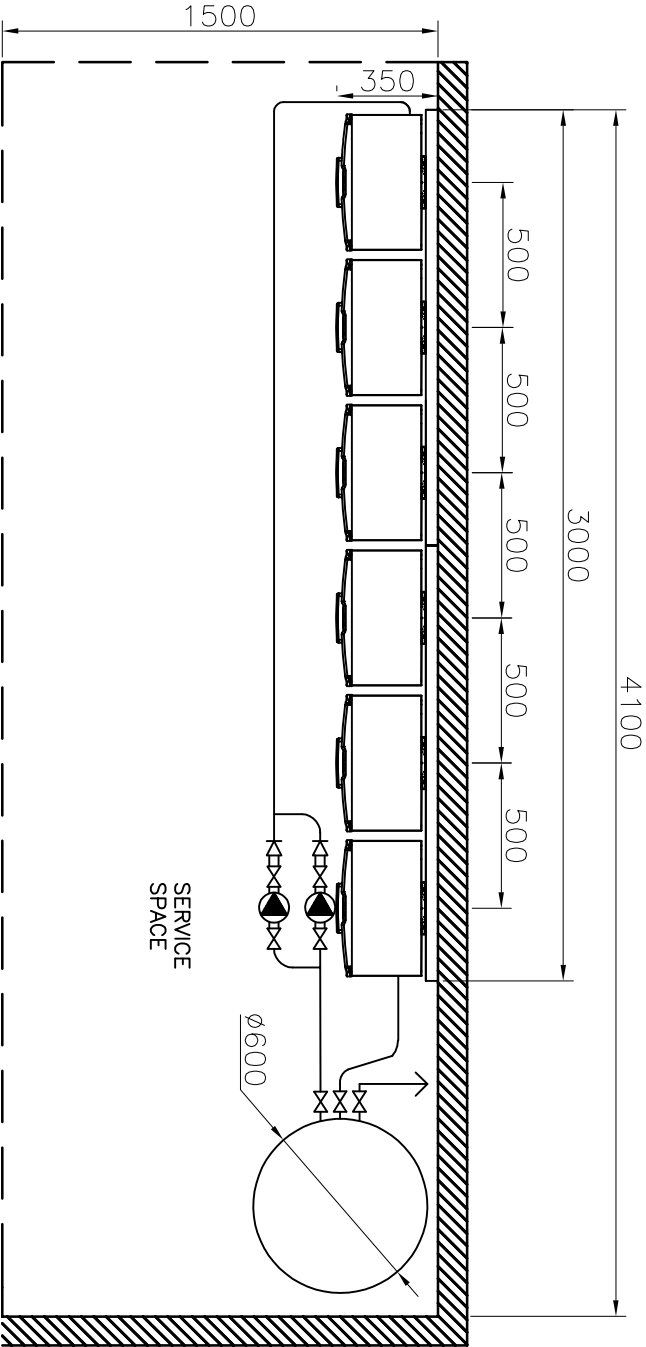

MATERIAL		DRAWN		RMP		Rinnai Australia Pty Ltd DDF6210E-250/315N	
TOLERANCE -UNLESS STATED 0. ±1.0 0.0 ±0.5 Angular ±1°		DATE		1/04/20			
		CHECKED		SVL			
		APPROVED					
FINISH:		DO NOT SCALE DRAWING				Title	
		 THIRD ANGLE PROJECTION				Weight	
						SEE NOTES	
						Drawing Number(PART NO)	
						SK 0161	
						Revision	
						1	

D

D

A

A

B

B

C

C

1

2

3

4

5

6