
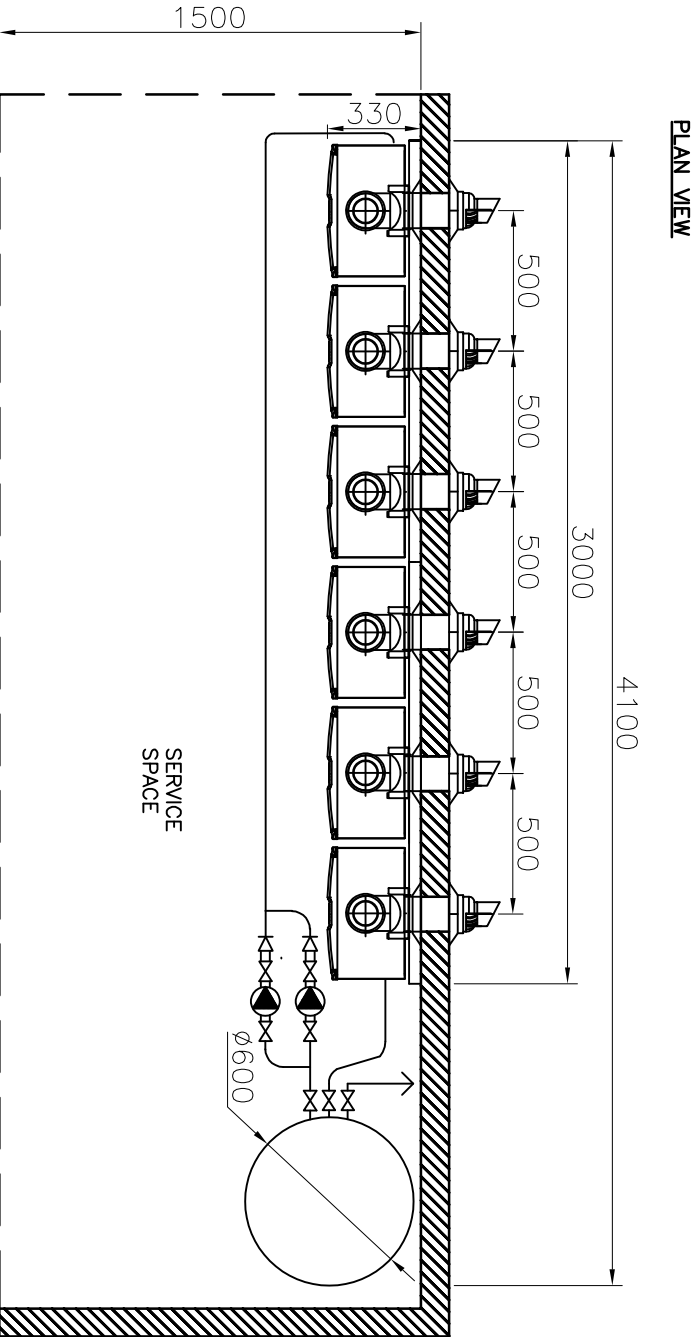


DRAWING CHANGES				
REV	ECN NO	DESCRIPTION	BY	CKD
DATE				

TANK WEIGHT: DRY WEIGHT:250L – 60kg 315L – 72kg WET WEIGHT:250L – 310kg 315L – 385kg	PRIMARY PUMP: DD6: 2xGRUNDFOFOS UPS32–100N HD210 HEATERS:	GENERAL NOTE: CONTROLLER REQUIRES: 1 X EXTERNAL GPO (10AMP) HEATERS REQUIRE: 1 X EXTERNAL GPO (10AMP) PER HEATER ** PLEASE NOTE ** DO NOT RUN CONDENSATE DRAIN IN COPPER. UPVC PIPE IS RECOMMENDED. (HIGHER TEMP AVAILABLE)
SYSTEM WEIGHT: DRY WEIGHT:250L – 308kg 315L – 320kg WET WEIGHT:250L – 558kg 315L – 633kg	SYSTEM GAS LOAD: 1245MJ –NG 1.13–3.00 kPa –LPG 2.75–3.00 kPa THERMOSTAT: FACTORY SET AT 65°	

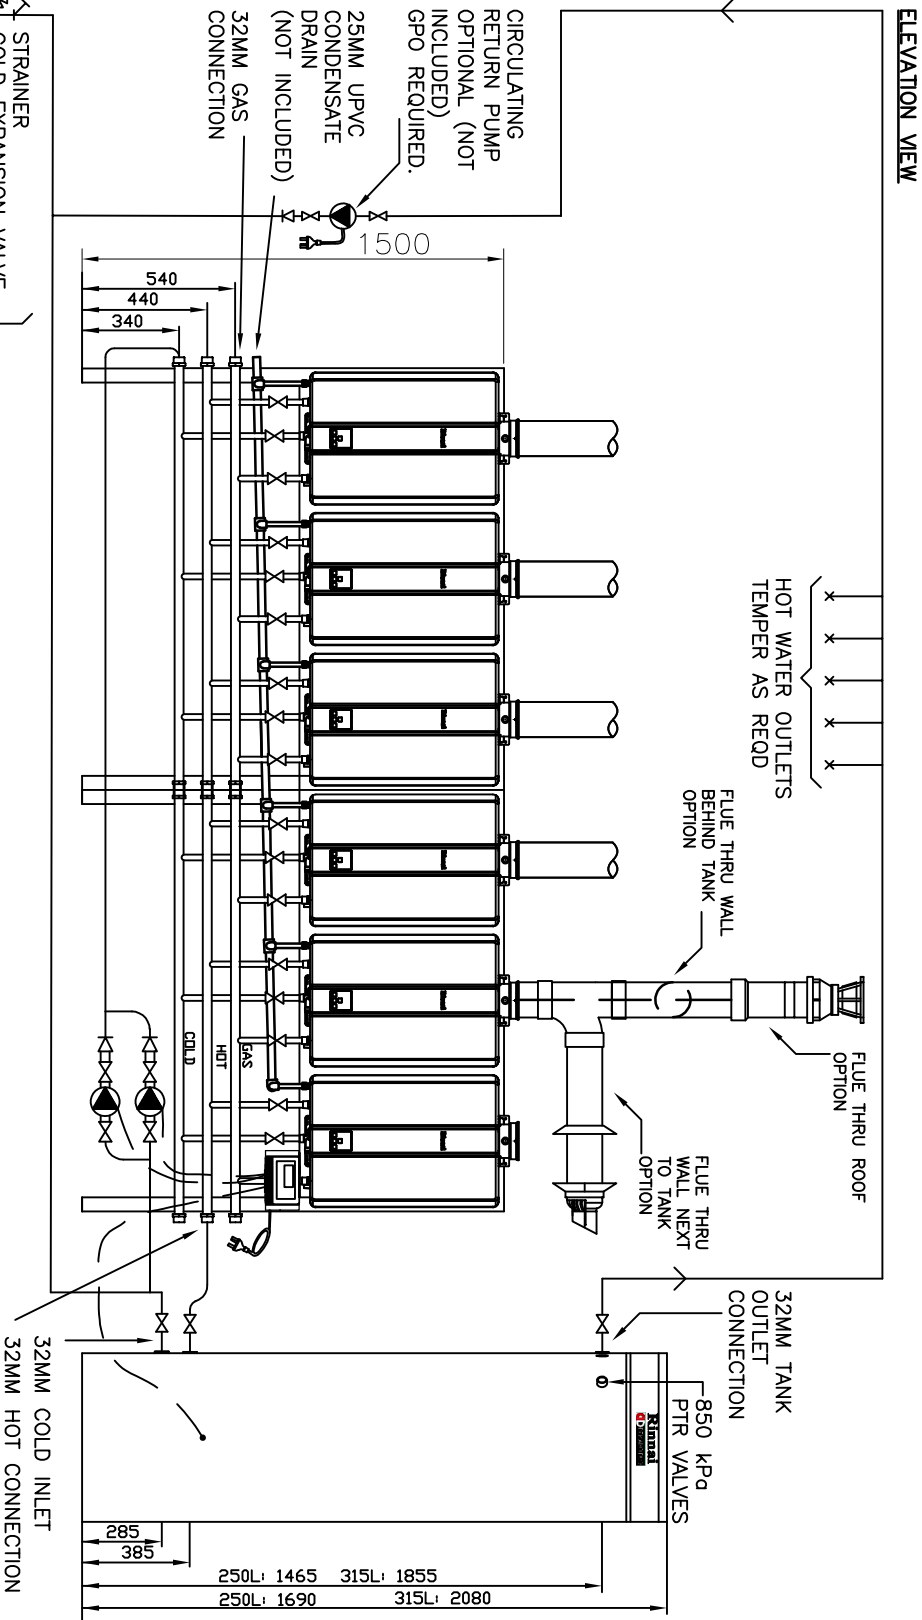

MATERIAL		DRAWN		RMP		Rinnai Australia Pty Ltd	
TOLERANCE –UNLESS STATED 0. ±1.0 0.0 ±0.5 Angular ±1°		DATE		13/02/20			
		CHECKED		SVL			
		APPROVED					
DIMENSIONS ARE IN MILLIMETERS AS 1100 		THIRD ANGLE PROJECTION				Title DDF6210I–250/315N	
FINISH:		DO NOT SCALE DRAWING					
Weight SEE NOTES				Drawing Number(PART NO) SK 0167		Revision 1	

Rinnai Australia Pty Ltd