


DRAWING CHANGES


REV	ECN NO	DESCRIPTION	BY	CKD	DATE

ELEVATION VIEW

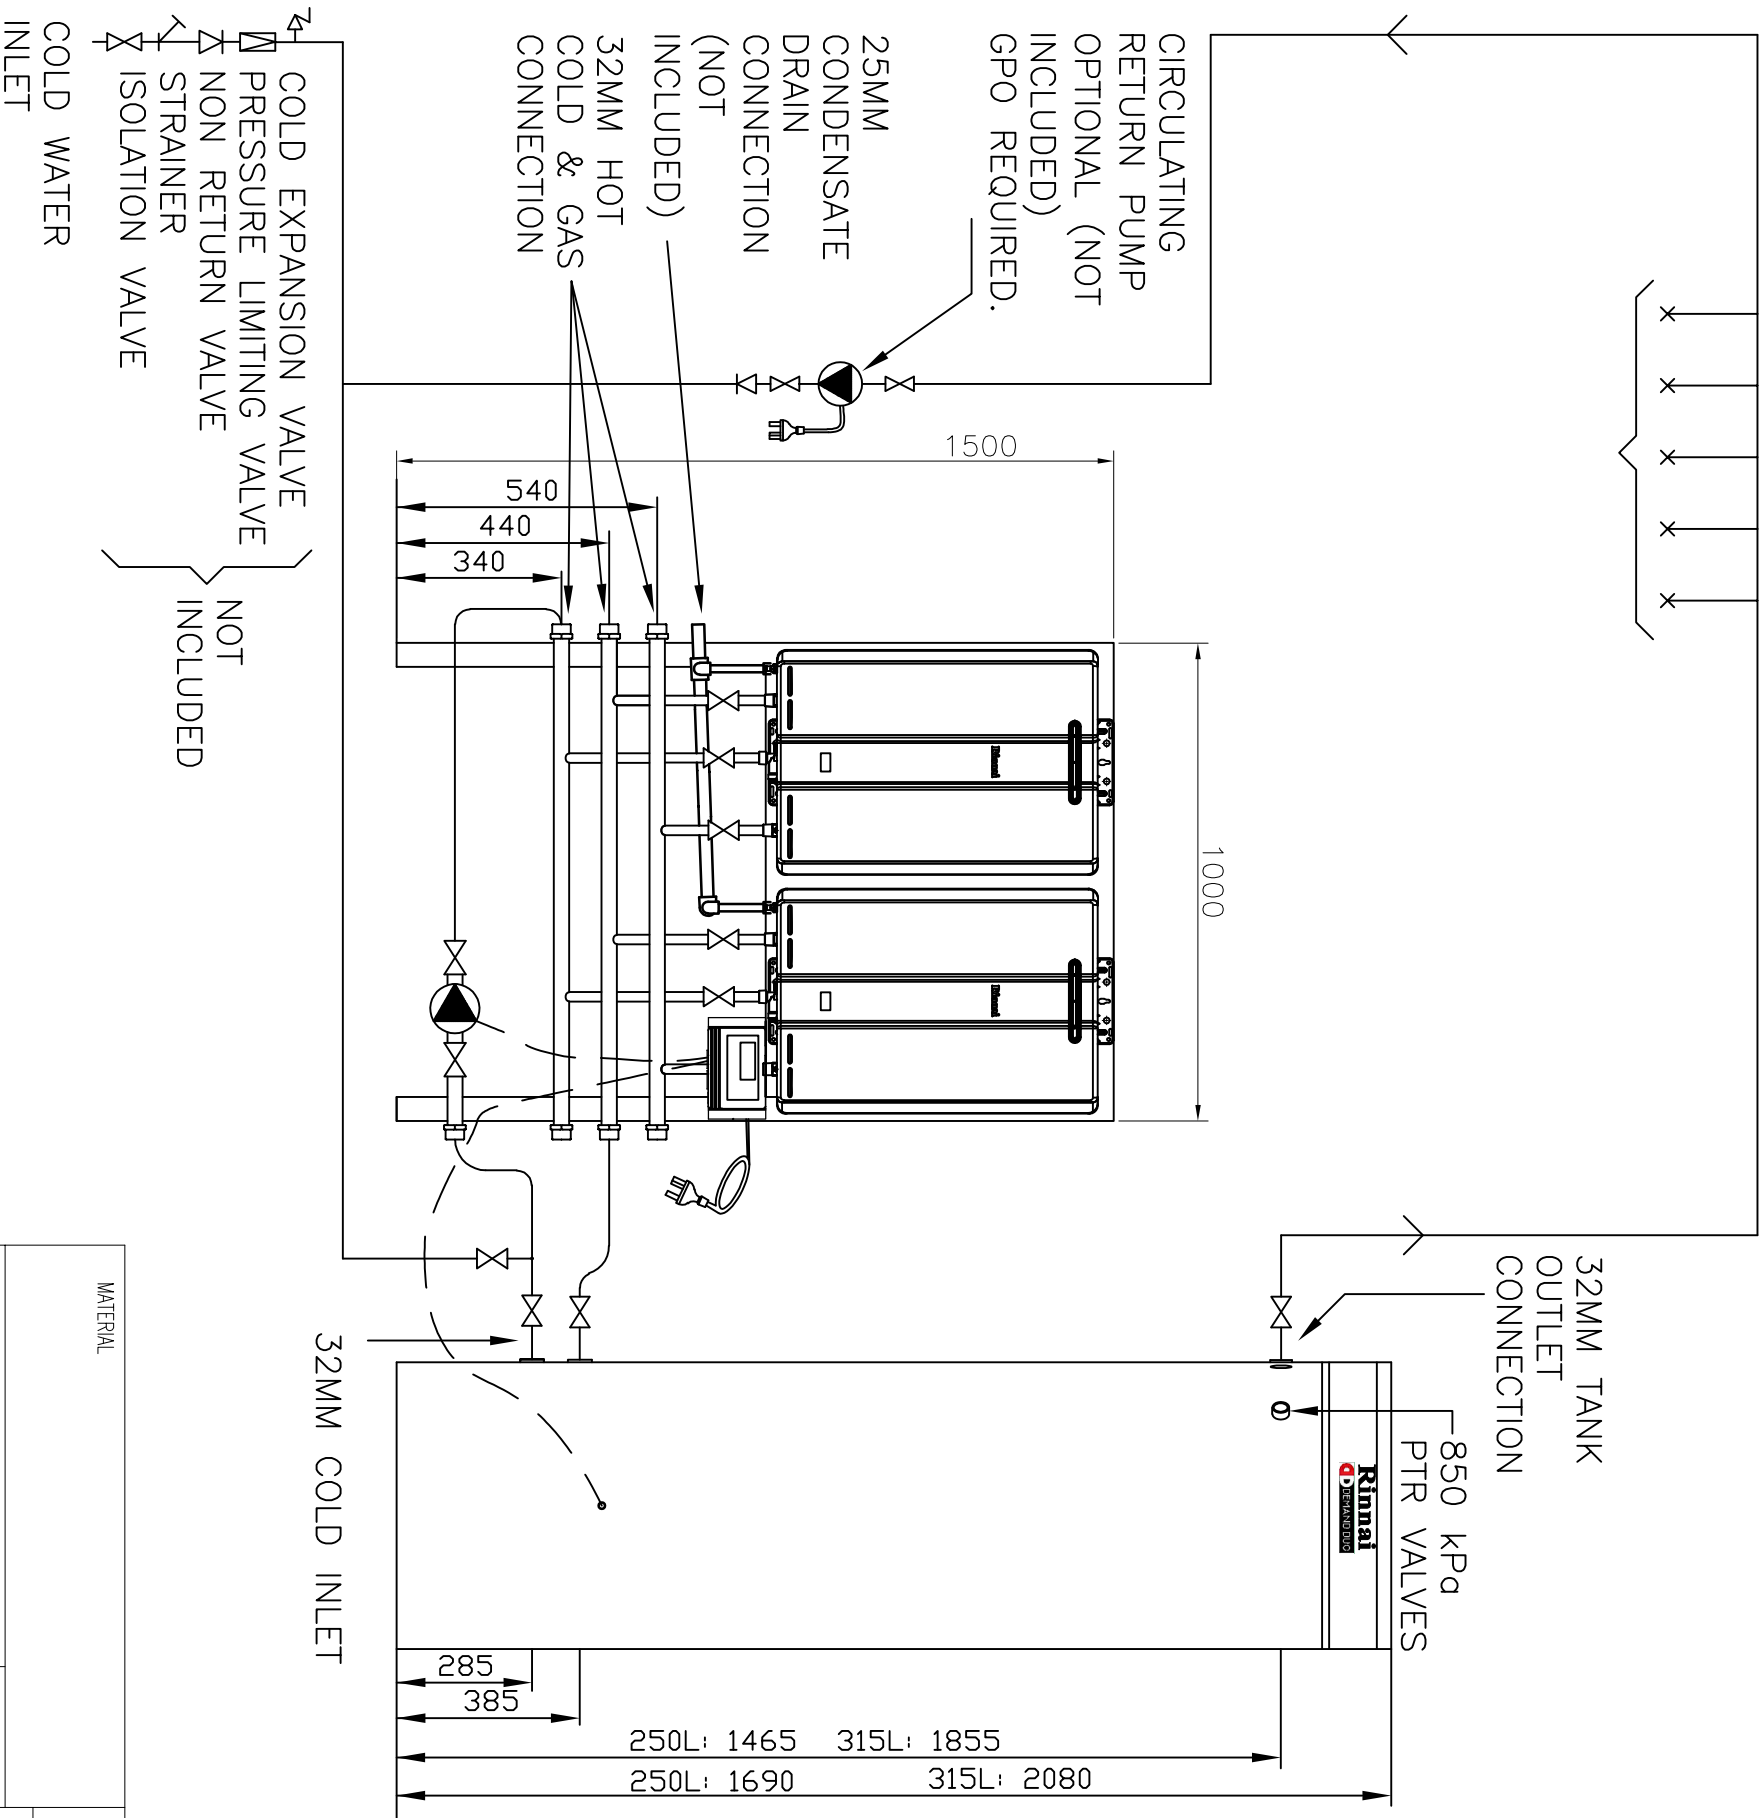

TANK WEIGHT:	PRIMARY PUMP:	GENERAL NOTE:
DRY WEIGHT: 250L - 60kg	DD2: 1xGRUNDFOSS	SYSTEM REQUIRES:
315L - 72kg	UPS32-100N	1 X EXTERNAL GPO (10AMP)
WET WEIGHT: 250L - 310kg		HEATERS REQUIRE:
315L - 385kg	THERMOSTAT:	2 X EXTERNAL GPO (10AMP)
SYSTEM WEIGHT:	FACTORY SET AT 65°	** PLEASE NOTE **
DRY WEIGHT: 250L - 143kg	(HIGHER TEMP AVAILABLE)	DO NOT RUN CONDENSATE DRAIN
315L - 155kg		IN COPPER. UPVC PIPE
WET WEIGHT: 250L - 393kg	HD210 HEATERS:	IS RECOMMENDED.
315L - 468kg	SYSTEM GAS LOAD: 418MJ	
	-NG 1.13-3.00 kPa	
	-LPG 2.75-3.00 kPa	

PLAN VIEW

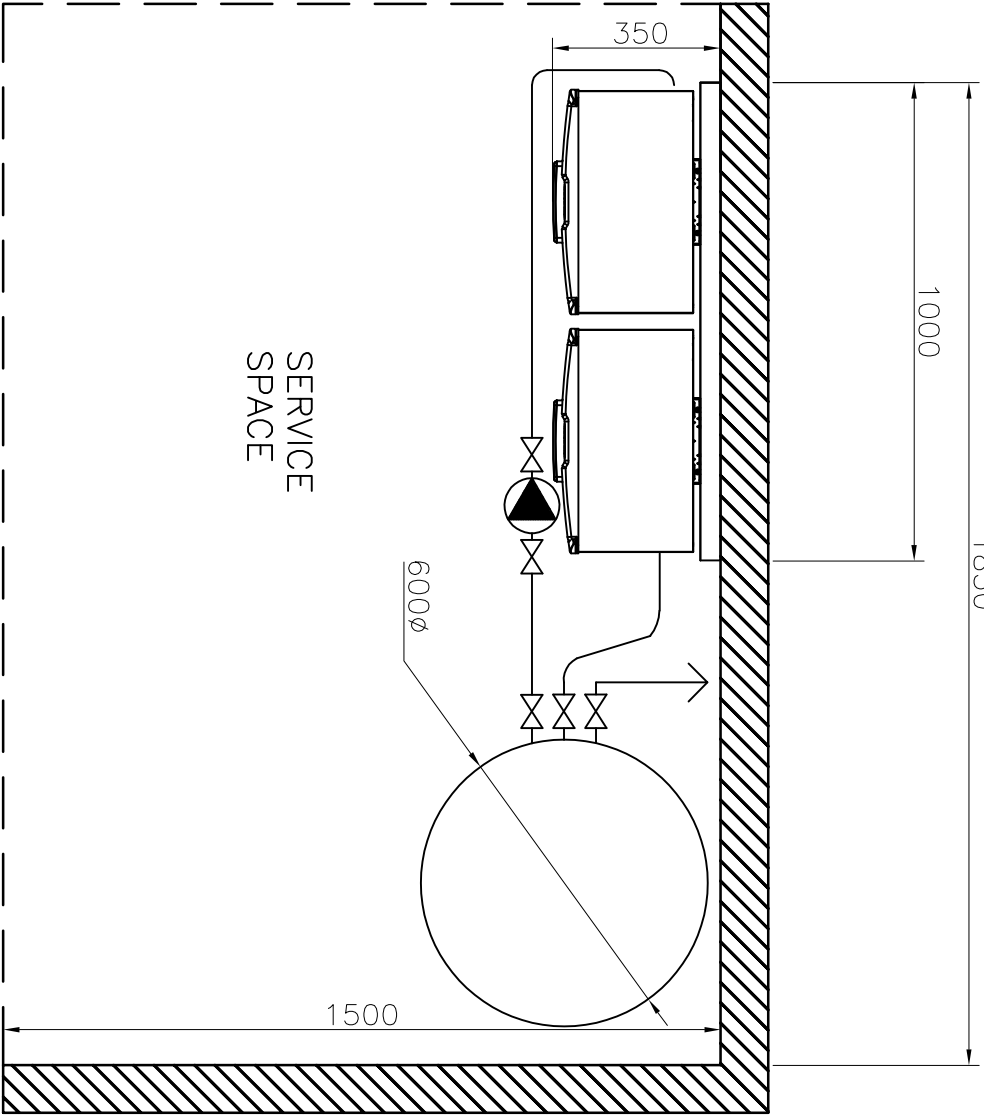

MATERIAL		DRAWN		RMP		Rinnai Australia Pty Ltd		
		DATE		15/7/20				
		CHECKED		SVL				
		APPROVED						
TOLERANCE –UNLESS STATED		DIMENSIONS ARE IN MILLIMETERS AS 1100				Title DDF2210E–250/315N		
0. ±1.0								
0.0 ±0.5		THIRD ANGLE PROJECTION						
Angular ±1°								
FINISH:		DO NOT SCALE DRAWING				Weight SEE NOTES		
						Drawing Number(PART NO) SK 0157		
						Revision 1		

DO NOT SCALE DRAWING

Rinnai Australia Pty Ltd