
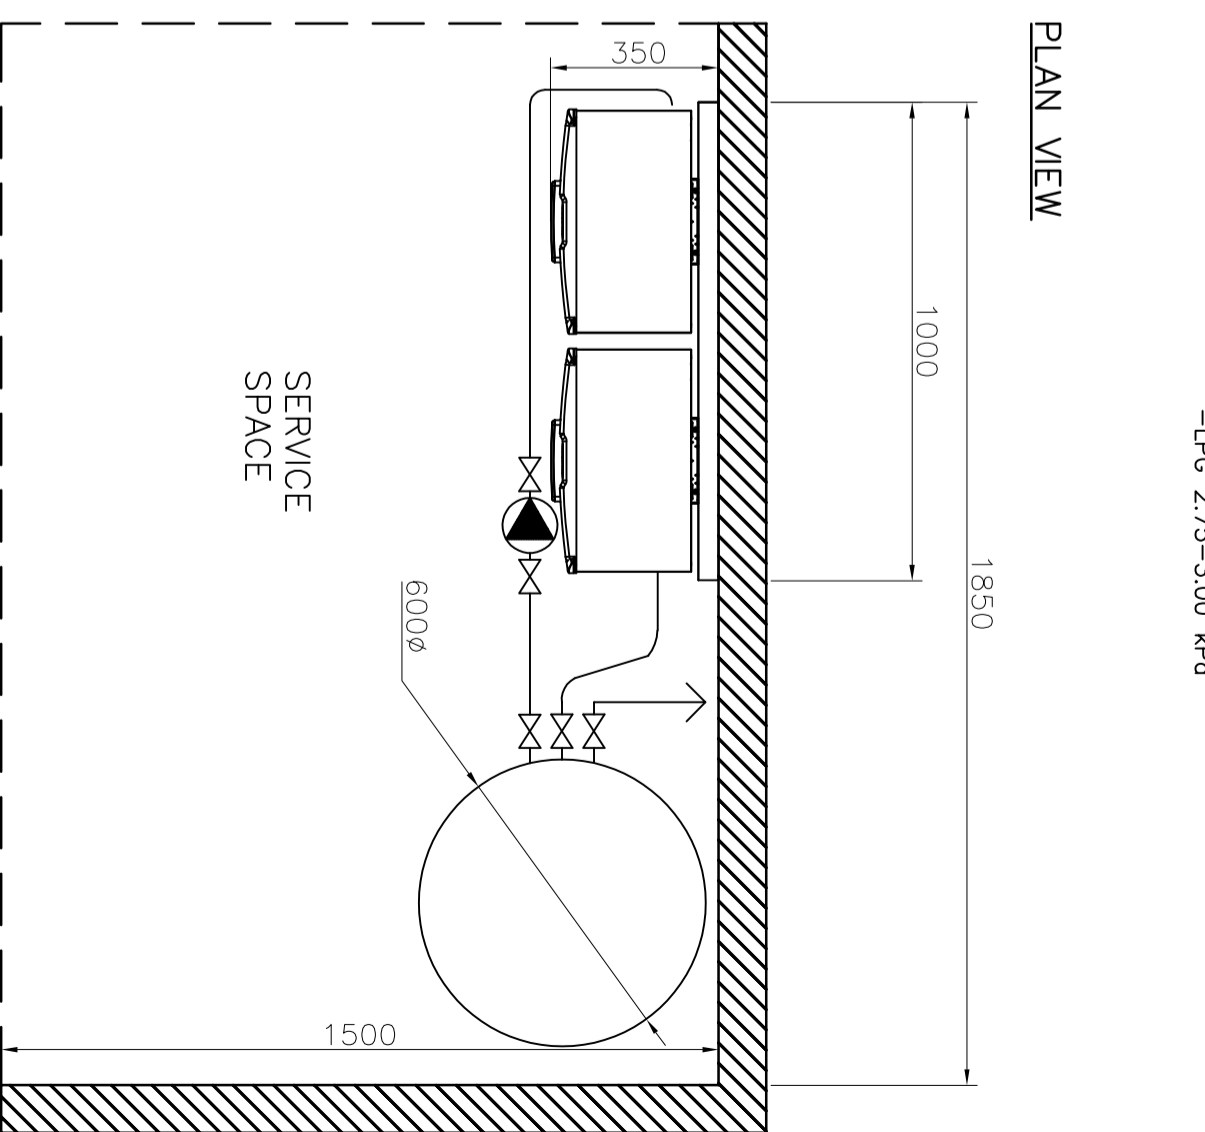
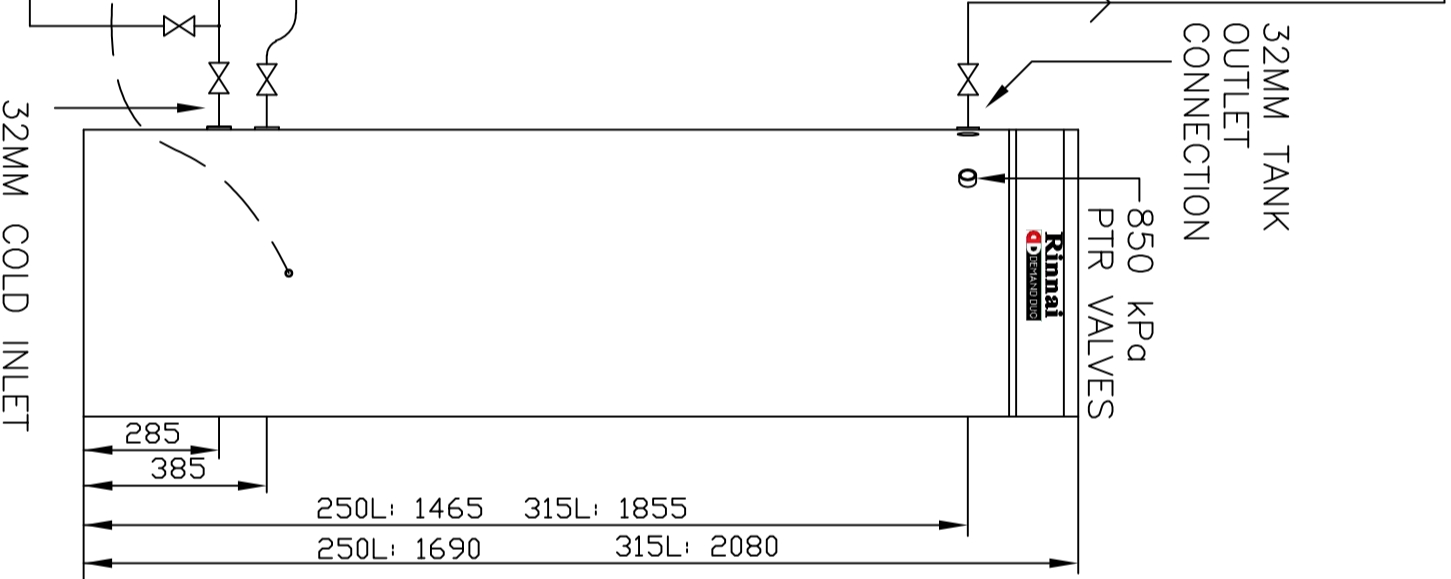


**ELEVATION VIEW**

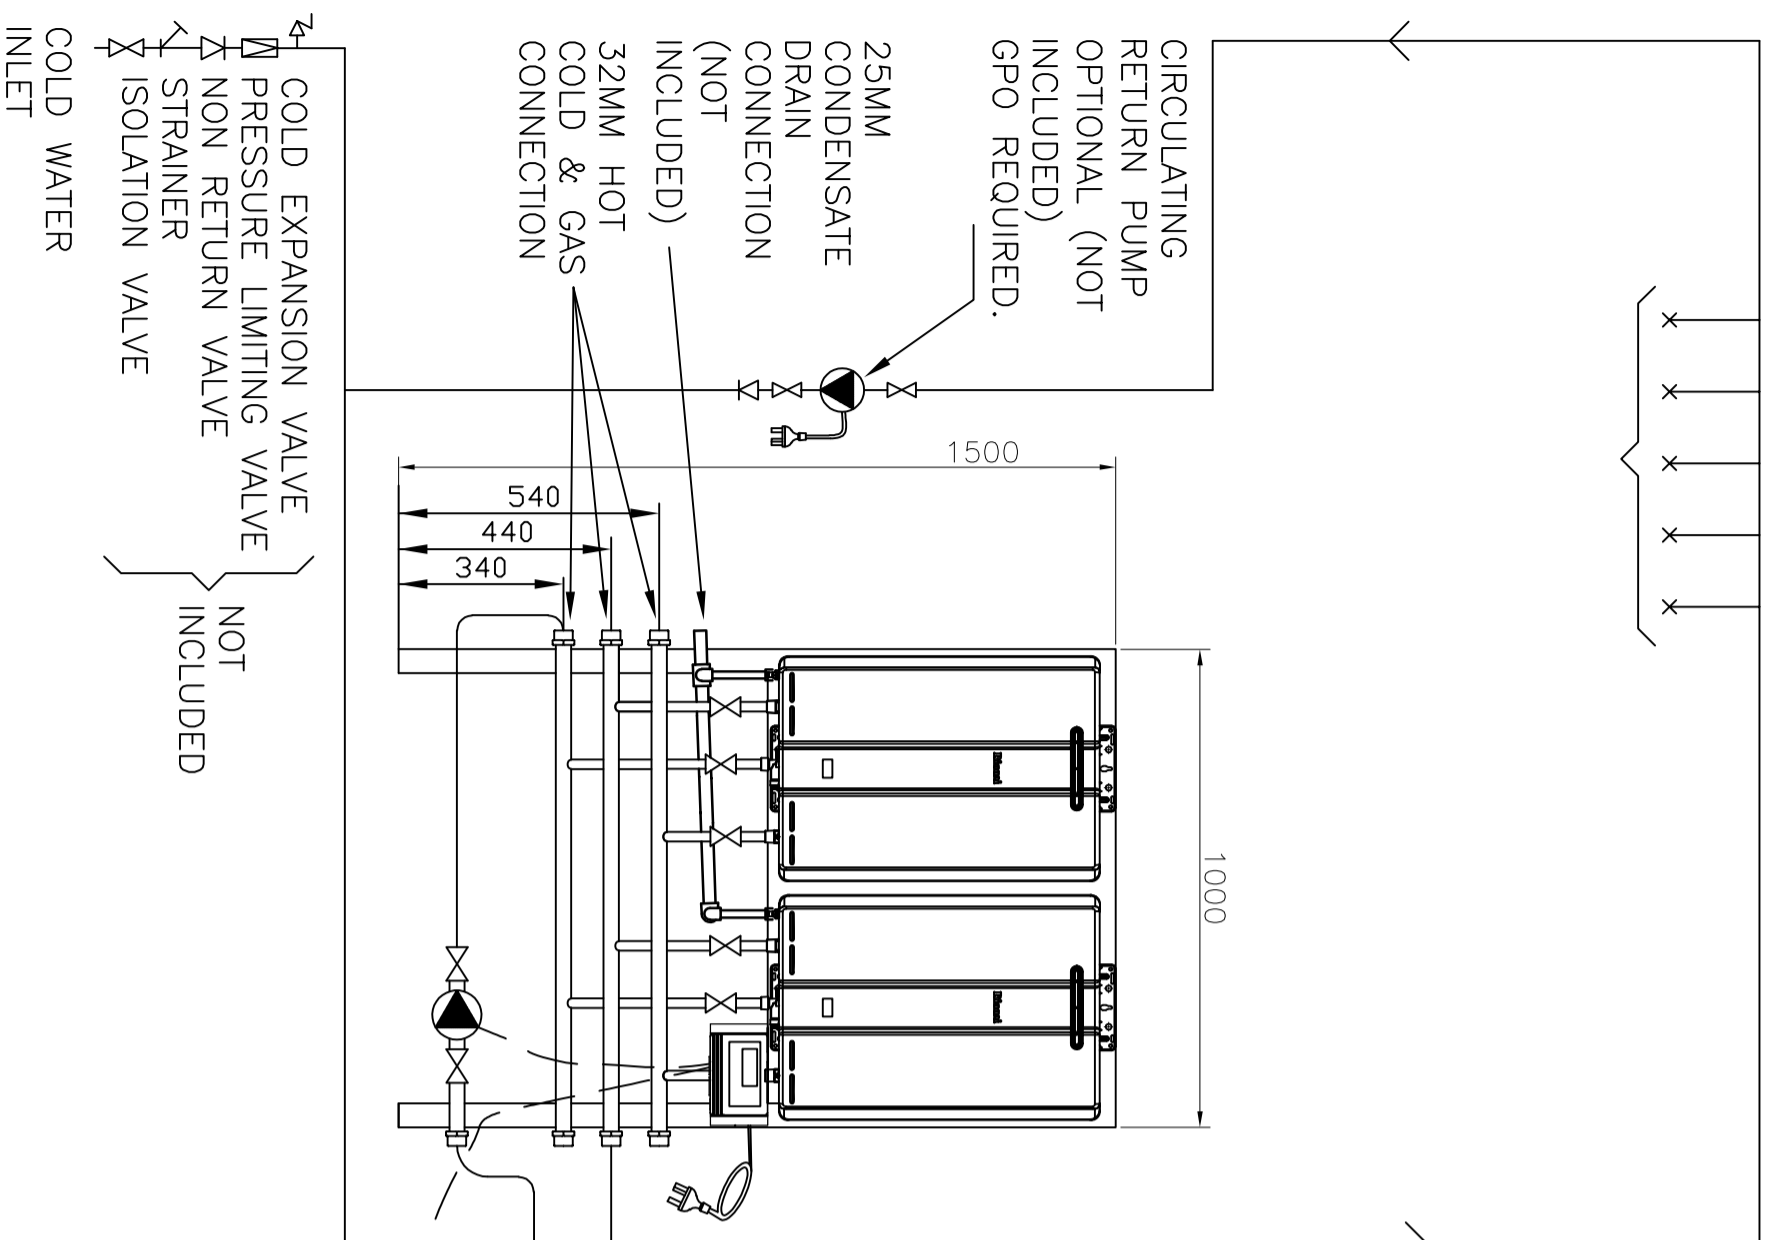

**TANK WEIGHT:**  
 DRY WEIGHT: 250L - 60kg  
 315L - 72kg  
 WET WEIGHT: 250L - 310kg  
 315L - 385kg  
**SYSTEM WEIGHT:**  
 DRY WEIGHT: 250L - 143kg  
 315L - 155kg  
 WET WEIGHT: 250L - 393kg  
 315L - 468kg

**PRIMARY PUMP:**  
 DD2: 1xGRUNDFOS  
 UPS32-100N  
**THERMOSTAT:**  
 FACTORY SET AT 65°  
 (HIGHER TEMP AVAILABLE)  
**\*\* PLEASE NOTE \*\***  
 DO NOT RUN CONDENSATE DRAIN  
 IN COPPER. UPVC PIPE  
 IS RECOMMENDED.  
**SYSTEM GAS LOAD: 418MJ**  
 -NG 1.13-3.00 KPa  
 -LPG 2.75-3.00 KPa

**GENERAL NOTE:**  
 SYSTEM REQUIRES:  
 1 X EXTERNAL GPO (10AMP)  
 HEATERS REQUIRE:  
 2 X EXTERNAL GPO (10AMP)  
**\*\* PLEASE NOTE \*\***  
 DO NOT RUN CONDENSATE DRAIN  
 IN COPPER. UPVC PIPE  
 IS RECOMMENDED.

**PLAN VIEW**

DRAWING CHANGES					
REV	ECN NO	DESCRIPTION	BY	CKD	DATE

MATERIAL	TOLERANCE - UNLESS STATED	DIMENSIONS ARE IN MILLIMETERS AS 1:100	THIRD ANGLE PROJECTION
	0. ±1.0	0.00 ±0.1	
	0.0 ±0.5	Angular ±1°	
FINISH:			

DRAWN	RMP	DATE	15/7/20
CHECKED	SVL	APPROVED	

**Rinnai Australia Pty Ltd**

Title: **DDF2210E-250/315N**

Weight: **SEE NOTES**

Drawing Number(PART NO): **SK 0157**

Revision: **1**

**DO NOT SCALE DRAWING**