


ELEVATION VIEW

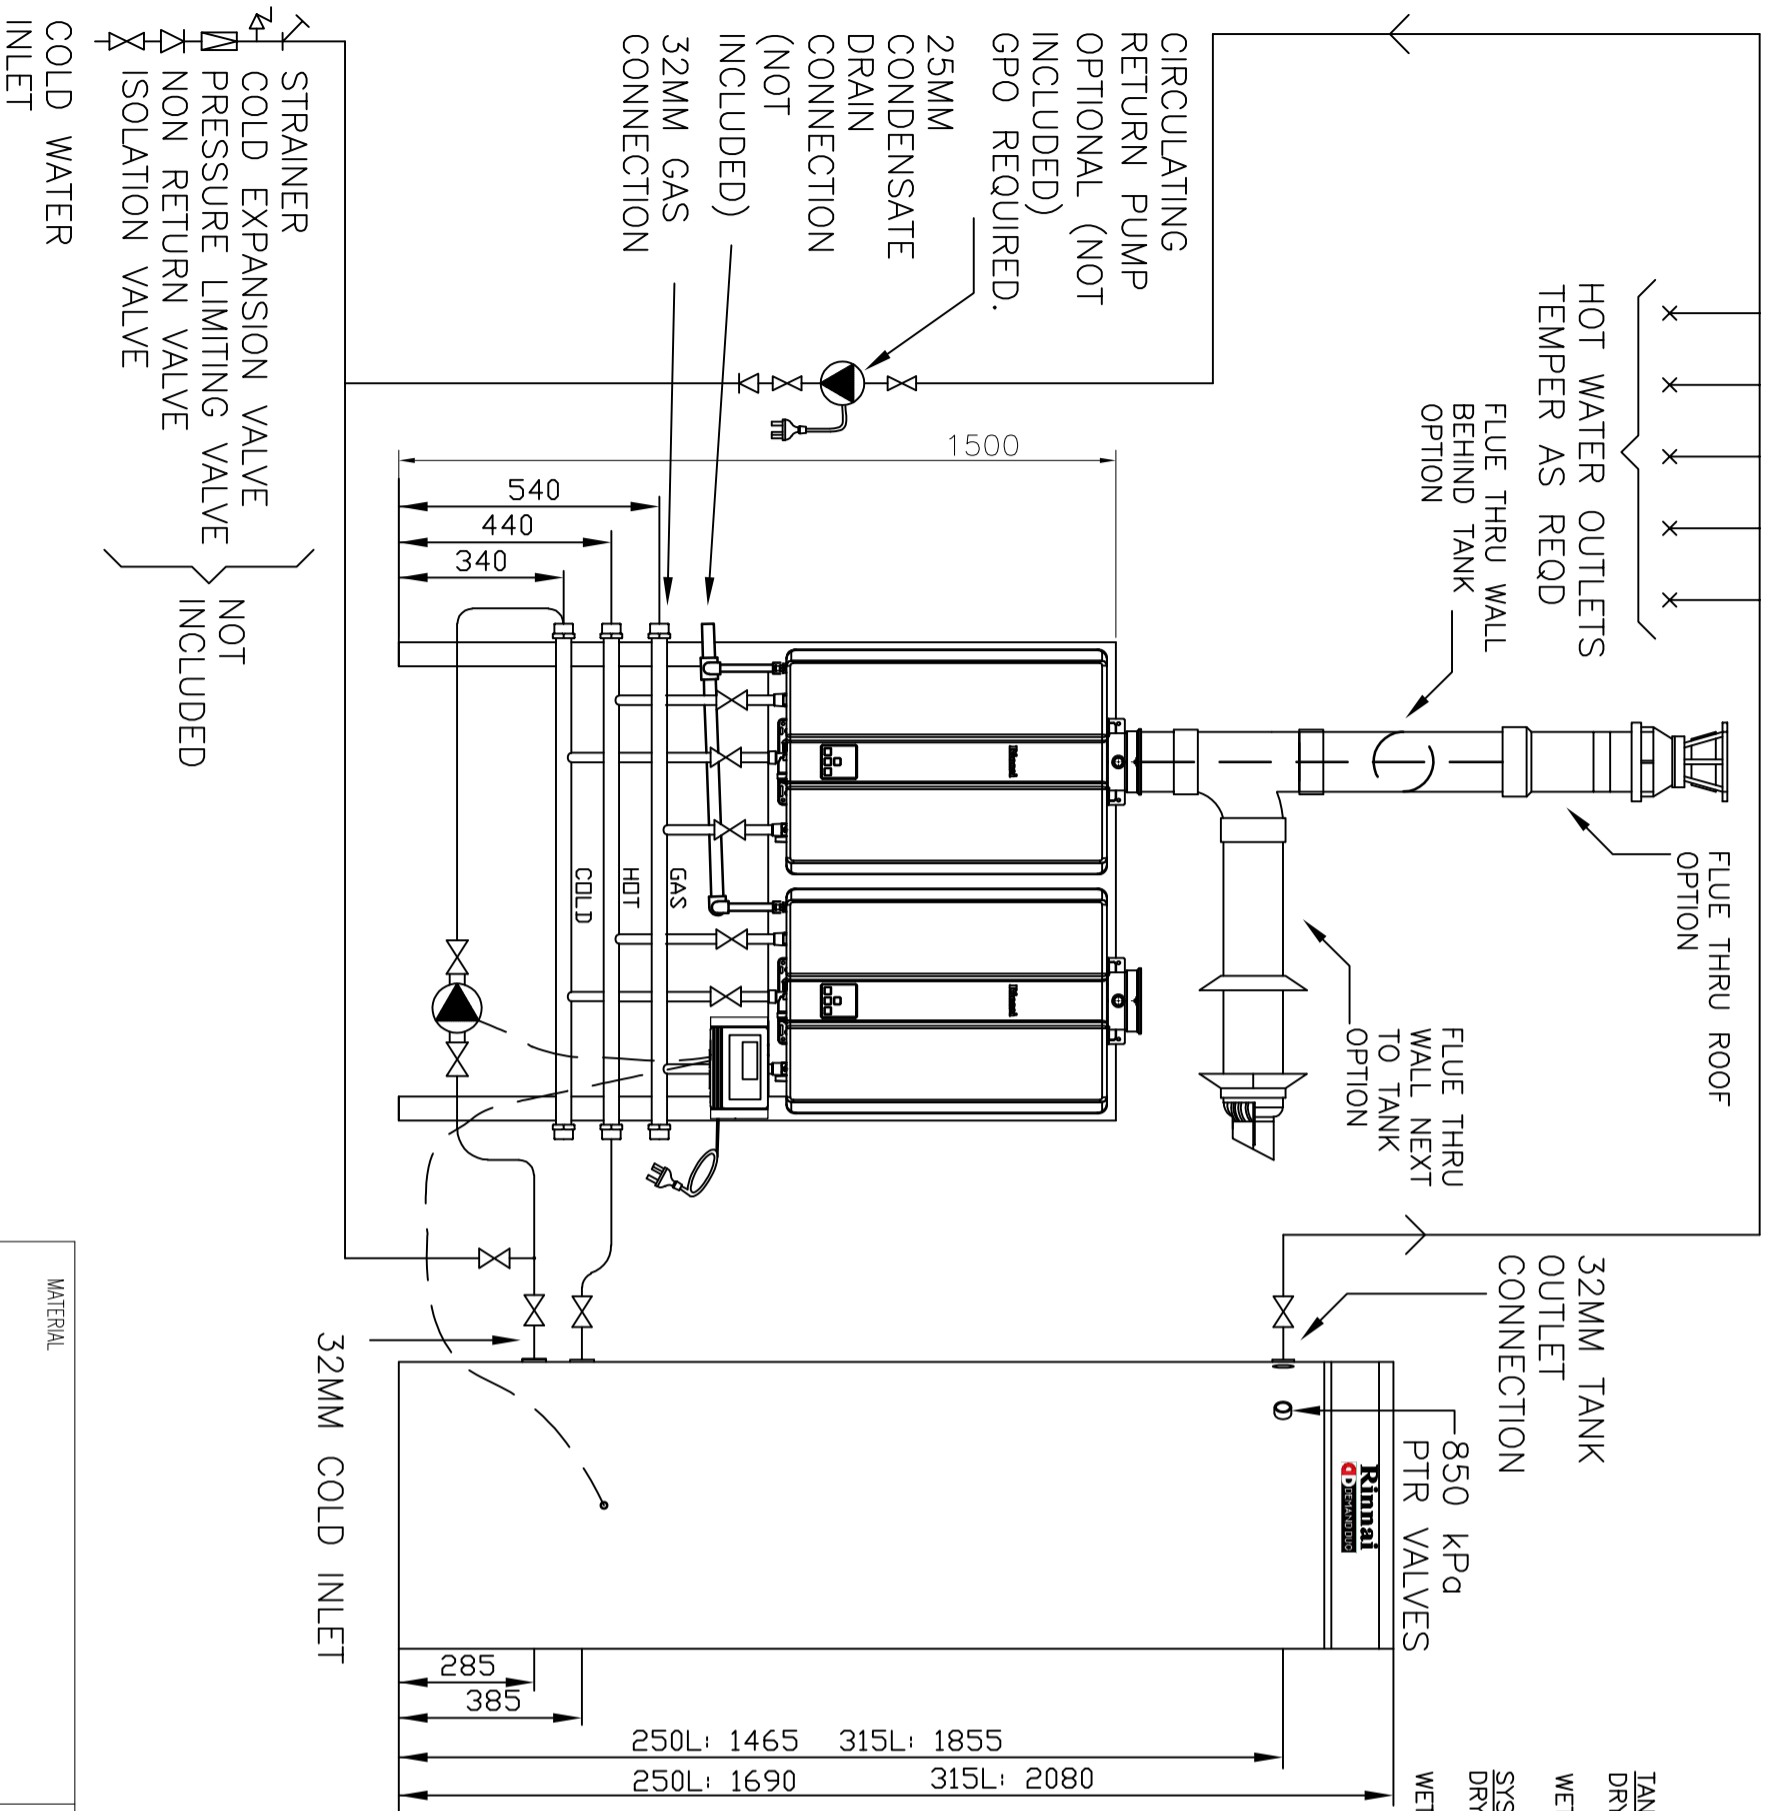

TANK WEIGHT:

DRY WEIGHT: 250L	- 60kg
315L	- 72kg
WET WEIGHT: 250L	- 310kg
315L	- 385kg


SYSTEM WEIGHT:

DRY WEIGHT: 250L	- 143kg
315L	- 155kg
WET WEIGHT: 250L	- 393kg
315L	- 468kg

PRIMARY PUMP:
 DD2: 1xGRUNDFOS UPS32-100N
 THERMOSTAT:
 FACTORY SET AT 65° (HIGHER TEMP AVAILABLE)
HD210 HEATERS:
 SYSTEM GAS LOAD: 418MJ
 -NG 1.13-3.00 KPa
 -LPG 2.75-3.00 KPa

GENERAL NOTE:
 CONTROLLER REQUIRES:
 1 X EXTERNAL GPO (10AMP)
 HEATERS REQUIRE:
 1 X EXTERNAL GPO (10AMP)
 ** PLEASE NOTE **
 DO NOT RUN CONDENSATE DRAIN IN COPPER.
 UPVC PIPE IS RECOMMENDED.

PLAN VIEW

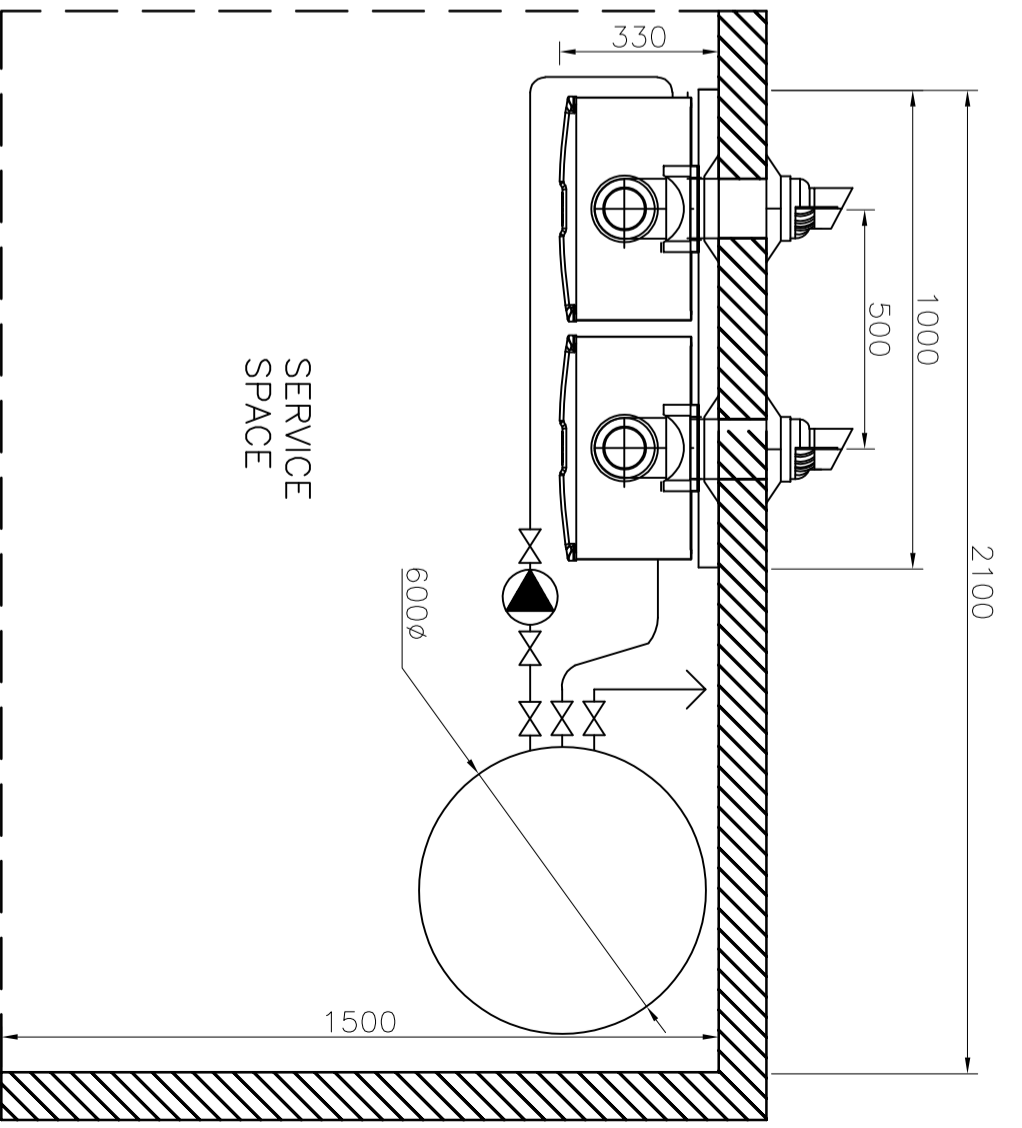

DRAWING CHANGES

REV	EON NO	DESCRIPTION	BY	CKD	DATE

MATERIAL		TOLERANCE - UNLESS STATED		DIMENSIONS ARE IN MILLIMETERS AS 1:100		THIRD ANGLE PROJECTION		DRAWN		RMP		Title	
0. ±1.0		0.00 ±0.1		Angular ±1°		APPROVED		DATE		23/01/20		DDF22101-250/315N	
0.0 ±0.5								CHECKED		SVL		SEE NOTES	
FINISH:												Drawing Number(PART NO)	
												SK 0163	
												Revision	
												1	

Rinnai Australia Pty Ltd

DO NOT SCALE DRAWING