
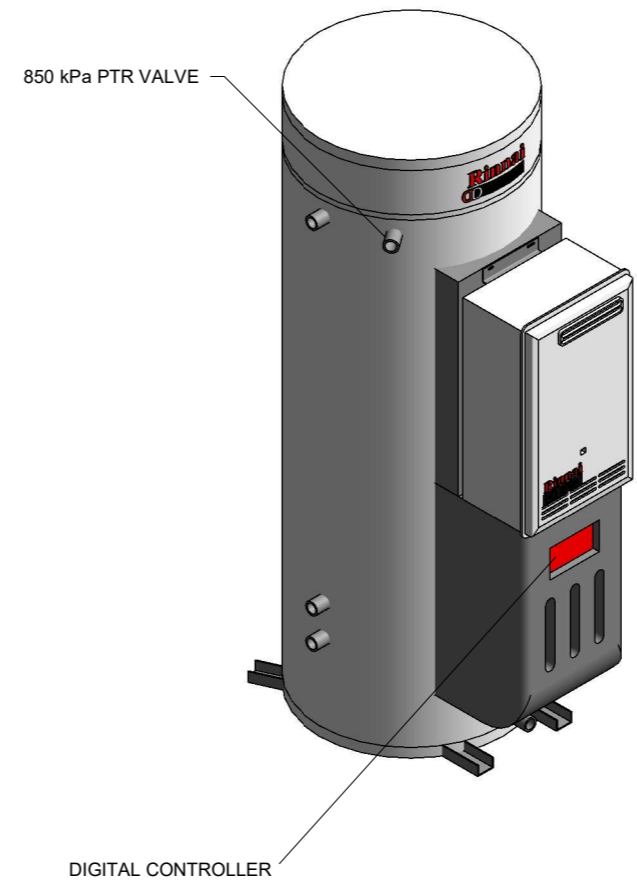
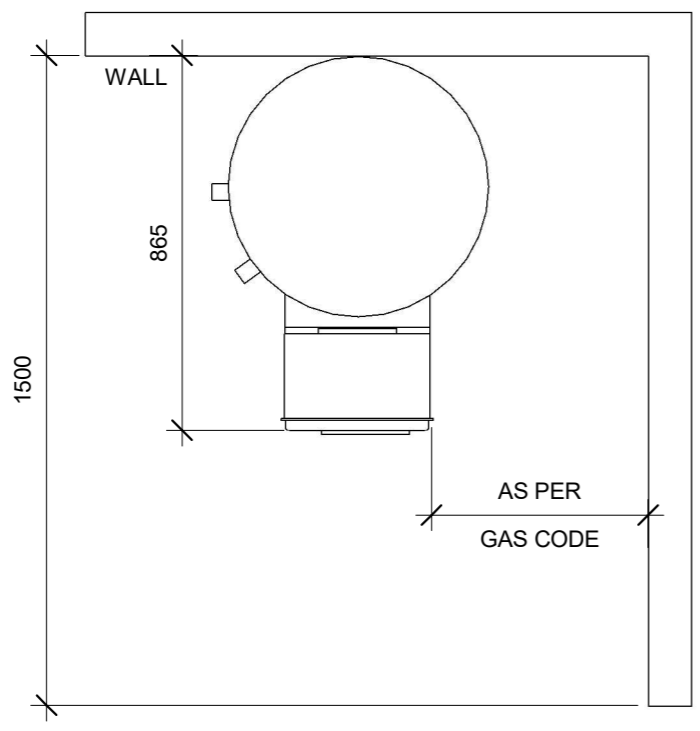


DRAWING CHANGES					
REV	ECN NO	DESCRIPTION	BY	CKD	DATE

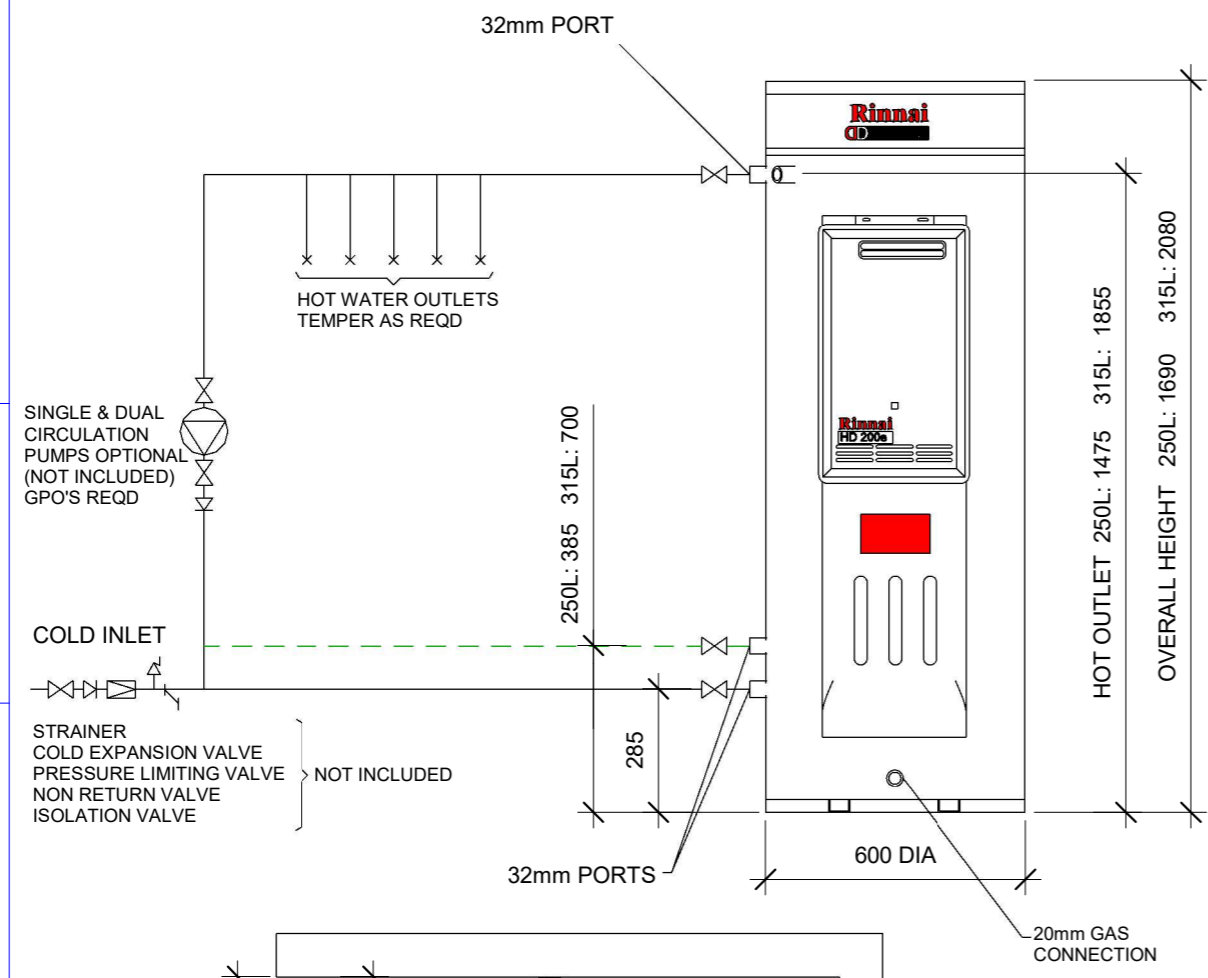

TANK

DRY WEIGHT: 250L - 80 Kg
315L - 92 Kg

WET WEIGHT: 250L - 330 Kg
315L - 407 Kg

HD200 HEATER

GAS LOAD EACH 200MJ
- NG 1.13 - 2.75 kPa
- LPG 2.75 kPa
FAN ASSISTED BALANCED FLUE

THERMOSTAT

FACTORY SET AT 65degC
(VARIOUS OTHER TEMSP AND FUNCTIONS AVAILABLE VIA THE CONTROLLER)

PRIMARY PUMP

DD1: 1 X GRUNDFOS UPS20-60N

GENERAL NOTE:

TANK REQUIRES ONE EXTERNAL GPO

MATERIAL		DRAWN	SVL	Rinnai Australia Pty Ltd	
TOLERANCE -UNLESS STATED		DATE	05/01/18		
0. ±1.0	0.00 ±0.1	CHECKED	CK	Title	
0.0 ±0.5	Angular ±1'	APPROVED		DD1200E NEW DESIGN STORAGE TANK	
FINISH:		DO NOT SCALE DRAWING		Weight	Revision
				Drawing Number(PART NO)	RA-05-01-18-002