


DRAWING CHANGES					
REV	ECN NO	DESCRIPTION	BY	CKD	DATE

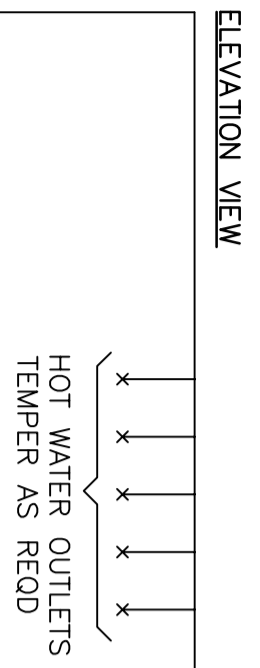

TANK WEIGHT:

250L	- 60kg
315L	- 72kg
250L	- 310kg
315L	- 385kg

SYSTEM WEIGHT:

250L	- 183kg
315L	- 195kg
250L	- 433kg
315L	- 508kg

PRIMARY PUMP:

DD3: 1XGRUNDFOS
UPS32-100N

HD210 HEATERS:

SYSTEM GAS LOAD: 627MJ

-NG 1.13-3.00 KPa


-LPG 2.75-3.00 KPa

THERMOSTAT:

FACTORY SET AT 65°
(HIGHER TEMP AVAILABLE)

GENERAL NOTE:

CONTROLLER REQUIRE:
1 X EXTERNAL GPO (10AMP)
HEATERS REQUIRE:
1 X EXTERNAL GPO (10AMP)
PER HEATER
** PLEASE NOTE **
DO NOT RUN CONDENSATE DRAIN
IN COPPER.
UPVC PIPE IS RECOMMENDED.

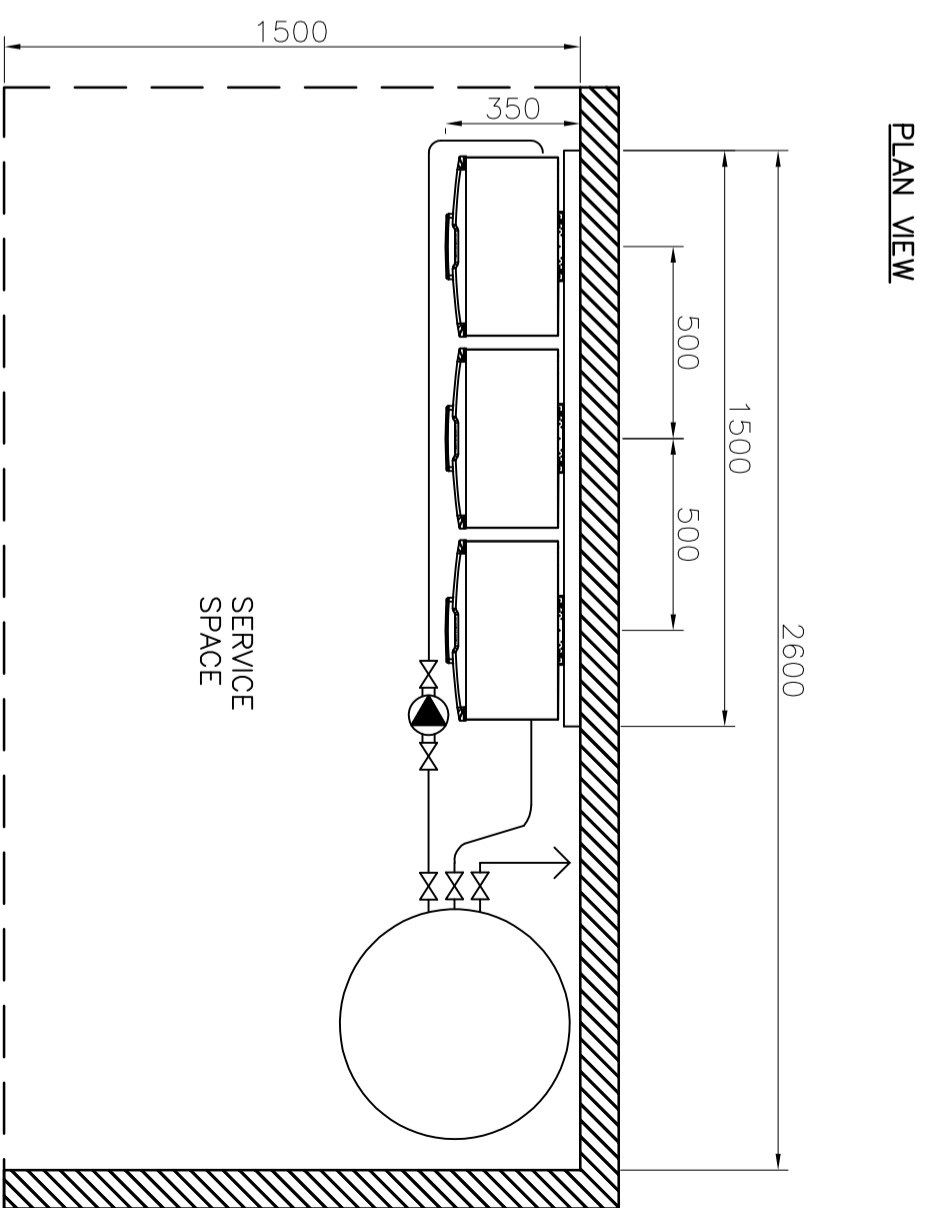

STRAINER

COLD EXPANSION VALVE

PRESSURE LIMITING VALVE

NON RETURN VALVE

ISOLATION VALVE

COLD WATER
INLET

NOT
INCLUDED

MATERIAL	TOLERANCE - UNLESS STATED		DIMENSIONS ARE IN MILLIMETERS AS 1:100	DATE	DRAWN	RMP	Title	Weight	Drawing Number(PART NO)	Revision
	0. ±1.0	0.0 ±0.1								
FINISH:	DO NOT SCALE DRAWING		THIRD ANGLE PROJECTION	APPROVED	Rinnai Australia Pty Ltd					