DRAWING CHANGES					
REV	ECN NO	DESCRIPTION	BY	CKD	DATE

TANK WEIGHT:
DRY WEIGHT: 250L – 60kg
315L – 72kg
WET WEIGHT: 250L – 310kg
315L – 385kg

SYSTEM WEIGHT:
DRY WEIGHT: 250L – 183kg
315L – 195kg
WET WEIGHT: 250L – 433kg
315L – 508kg

PRIMARY PUMP:
DD3: 1xGRUNDFOS UPS32–100N

HD210 HEATERS:
SYSTEM GAS LOAD: 627MJ
–NG 1.13–3.00 kPa
–LPG 2.75–3.00 kPa

THERMOSTAT:
FACTORY SET AT 65°
(HIGHER TEMP AVAILABLE)

GENERAL NOTE:
CONTROLLER REQUIRES:
1 X EXTERNAL GPO (10AMP)
HEATERS REQUIRE:
1 X EXTERNAL GPO (10AMP) PER HEATER
** PLEASE NOTE **
DO NOT RUN CONDENSATE DRAIN IN COPPER.
UPVC PIPE IS RECOMMENDED.

ELEVATION VIEW

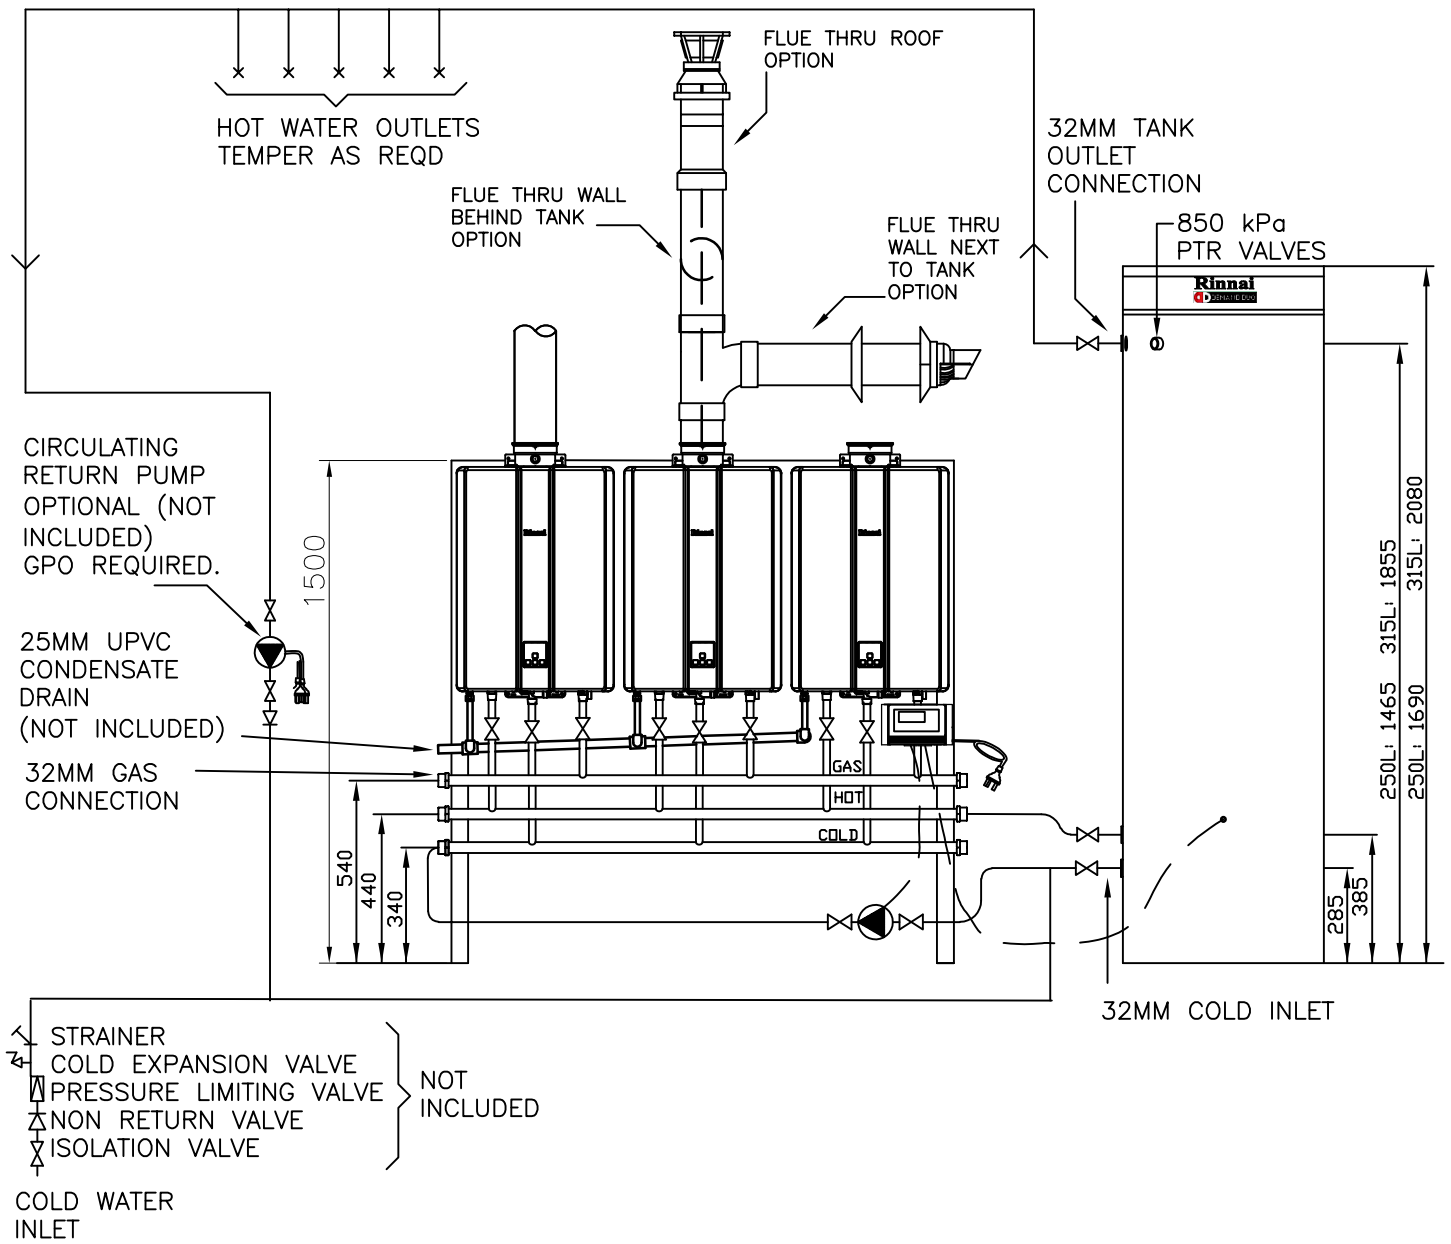

PLAN VIEW

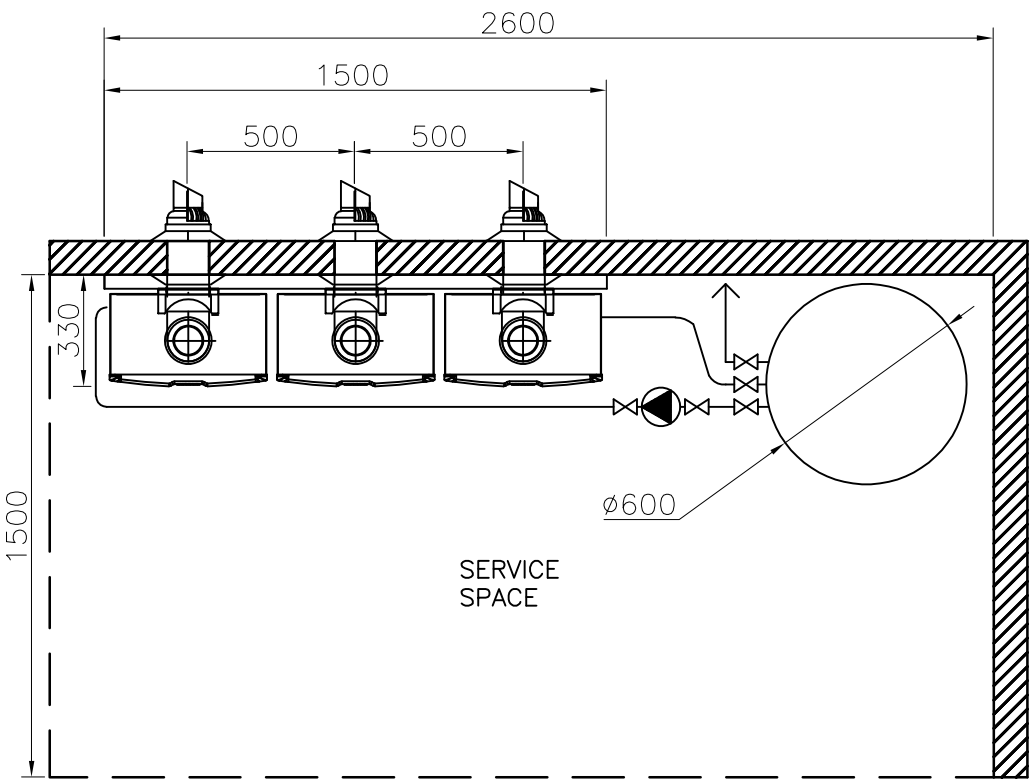

MATERIAL		DRAWN	RMP	**Rinnai** Australia Pty Ltd
TOLERANCE –UNLESS STATED 0. ±1.0 0.00 ±0.1 0.0 ±0.5 Angular ±1°	DIMINSIONS ARE IN MILLIMETERS AS 1100 THIRD ANGLE PROJECTION	DATE	23/01/20	Title: DDF3210I–250/315N
		CHECKED	SVL	
		APPROVED		
FINISH:	DO NOT SCALE DRAWING			Weight: SEE NOTES Drawing Number(PART NO): SK 0164 Revision: 1