



DRAWING CHANGES					
REV	ECN NO	DESCRIPTION	BY	CKD	DATE

ELEVATION VIEW

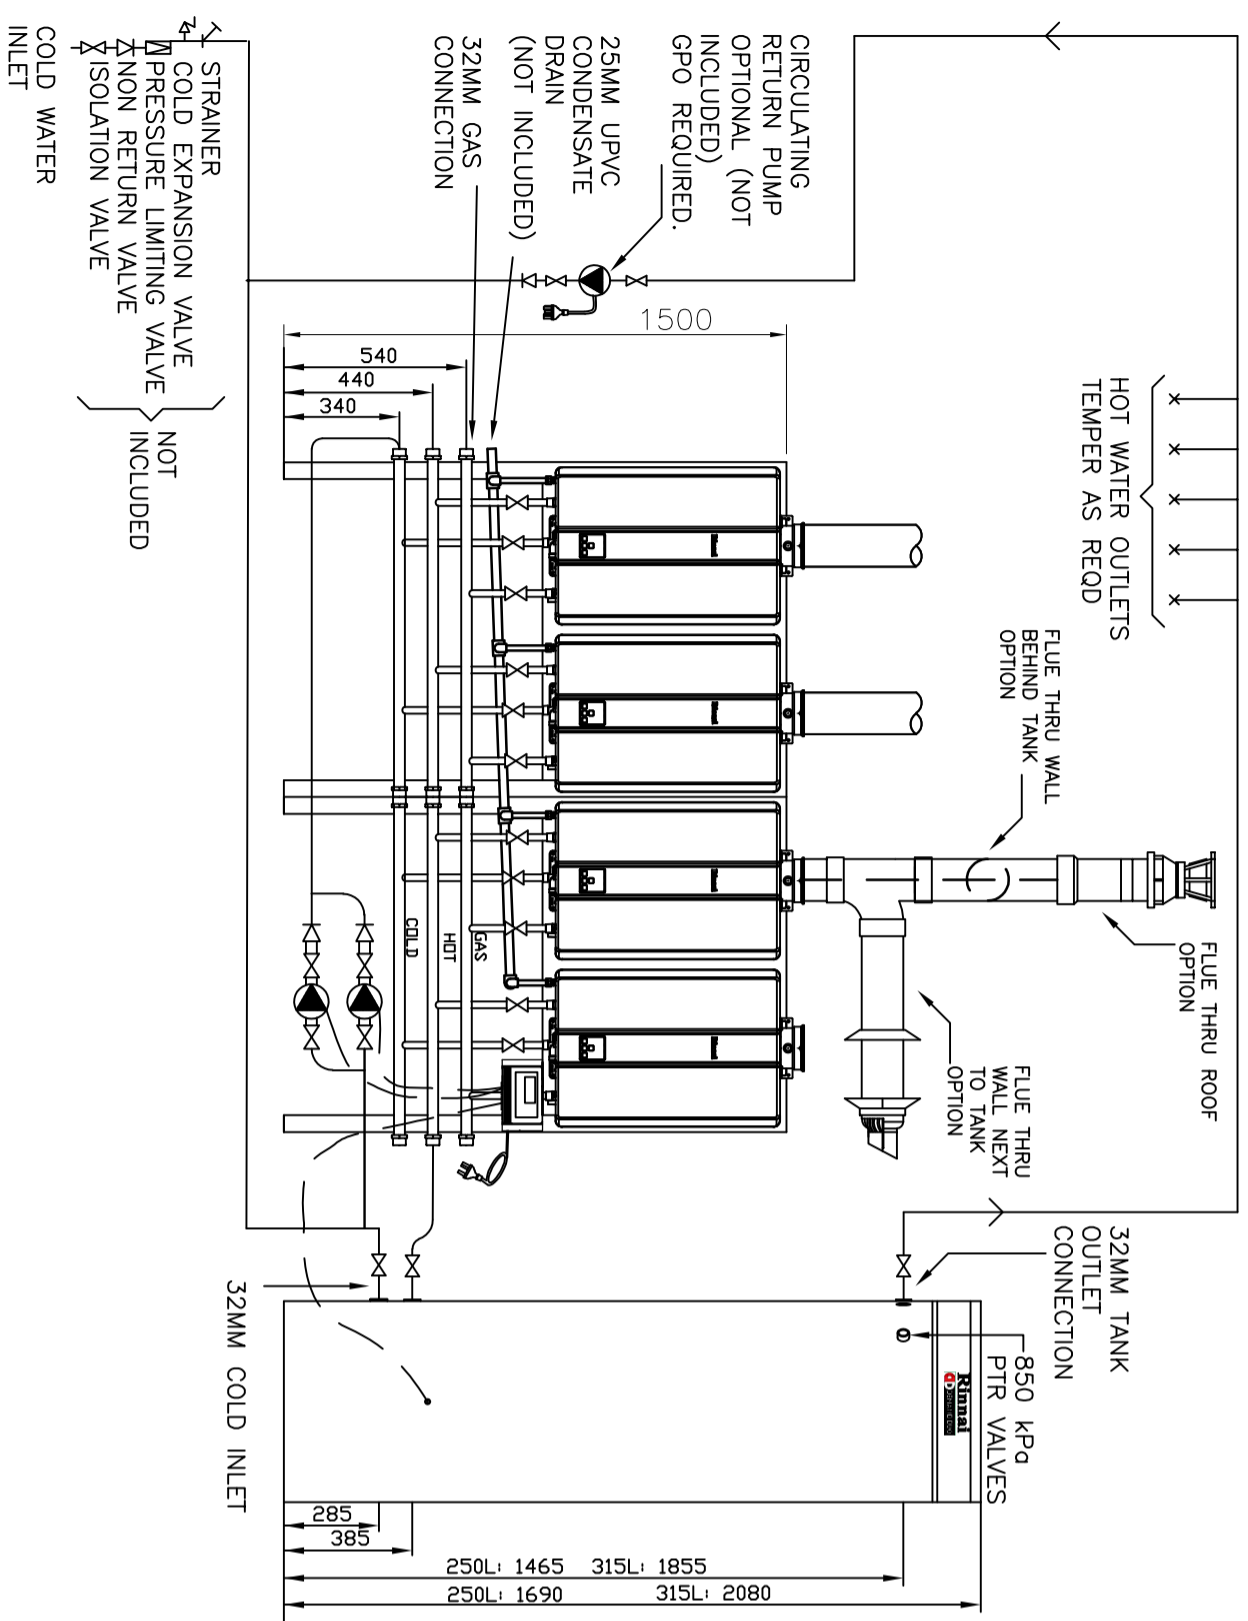

- TANK WEIGHT:**
 DRY WEIGHT: 250L - 60kg
 315L - 72kg
 WET WEIGHT: 250L - 310kg
 315L - 385kg
- SYSTEM WEIGHT:**
 DRY WEIGHT: 250L - 228kg
 315L - 240kg
 WET WEIGHT: 250L - 478kg
 315L - 553kg
- PRIMARY PUMP:**
 DD4: 2xGRUNDFOS
 UPS32-100N
 HD210 HEATERS:
 SYSTEM GAS LOAD: 836MJ
 -NG 1.13-3.00 KPa
 -LPG 2.75-3.00 KPa
THERMOSTAT:
 FACTORY SET AT 65°
 (HIGHER TEMP AVAILABLE)
- GENERAL NOTE:**
 CONTROLLER REQUIRES:
 1 X EXTERNAL GPO (10AMP)
 HEATERS REQUIRE:
 1 X EXTERNAL GPO (10AMP)
 PER HEATER
 ** PLEASE NOTE **
 DO NOT RUN CONDENSATE DRAIN
 IN COPPER.
 UPVC PIPE IS RECOMMENDED.

PLAN VIEW

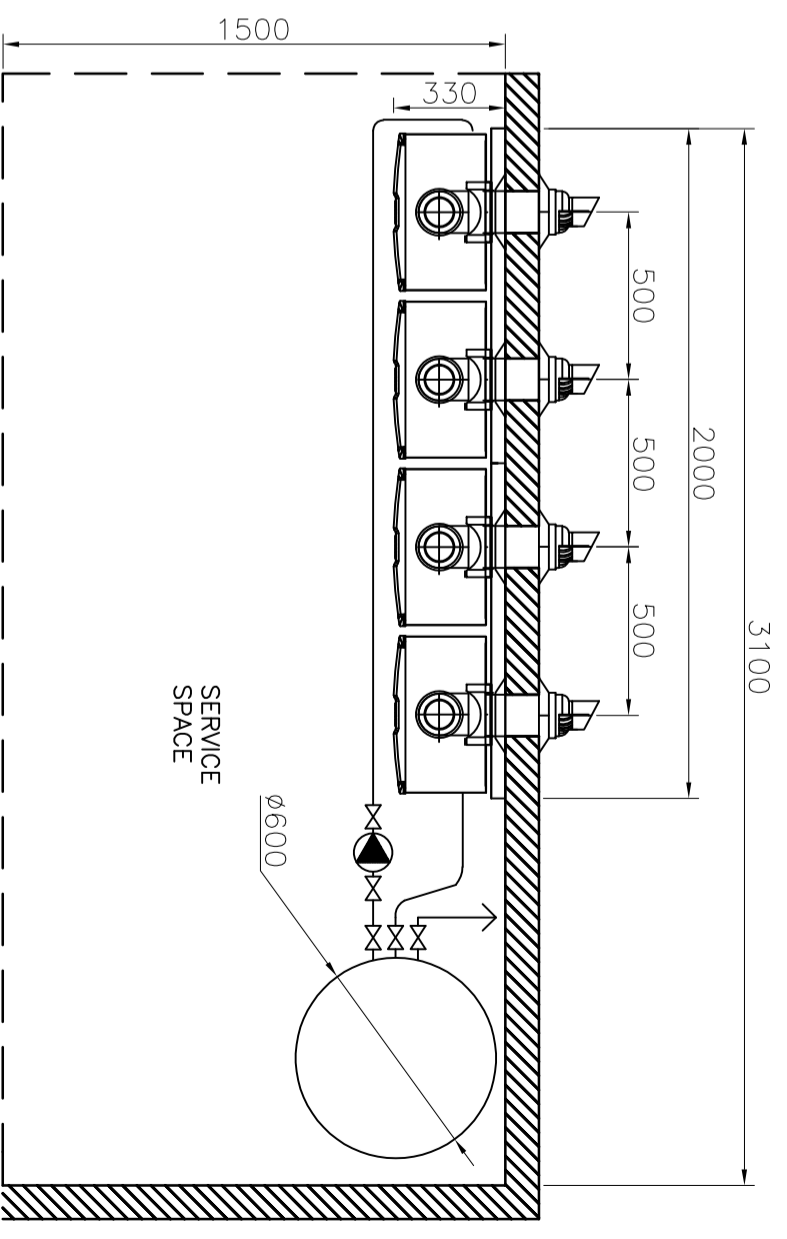

MATERIAL	TOLERANCE - UNLESS STATED		DIMENSIONS ARE IN MILLIMETERS AS 1:100	THIRD ANGLE PROJECTION	DRAWN	RMP	Title	Rinnai Australia Pty Ltd	Drawing Number(PART NO) SK 0165	Revision 1
	0. ±1.0	0.0 ±0.5			0.00 ±0.1	Angular ±1°				
DO NOT SCALE DRAWING										
Weight SEE NOTES										
DDF42101-250/315N										