

DRAWING CHANGES					
REV	ECON NO	DESCRIPTION	BY	CKD	DATE

TANK WEIGHT:
 DRY WEIGHT: 250L - 60kg
 315L - 72kg
 WET WEIGHT: 250L - 310kg
 315L - 385kg


SYSTEM WEIGHT:
 DRY WEIGHT: 250L - 308kg
 315L - 320kg
 WET WEIGHT: 250L - 558kg
 315L - 633kg

PRIMARY PUMP:
 DD6: 2xGRUNDFOS
 UPS32-100N
 HD210 HEATERS:
 SYSTEM GAS LOAD: 1254MJ
 -NG 1.13-3.00 kPa
 -LPG 2.75-3.00 kPa
THERMOSTAT:
 FACTORY SET AT 65°
 (HIGHER TEMP AVAILABLE)


GENERAL NOTE:
 CONTROLLER REQUIRE:
 1 X EXTERNAL GPO (10AMP)
 HEATERS REQUIRE:
 1 X EXTERNAL GPO (10AMP)
 PER HEATER
 ** PLEASE NOTE **
 DO NOT RUN CONDENSATE DRAIN
 IN COPPER.
 UPVC PIPE IS RECOMMENDED.

HOT WATER OUTLETS
 TEMPER AS REQD

ELEVATION VIEW

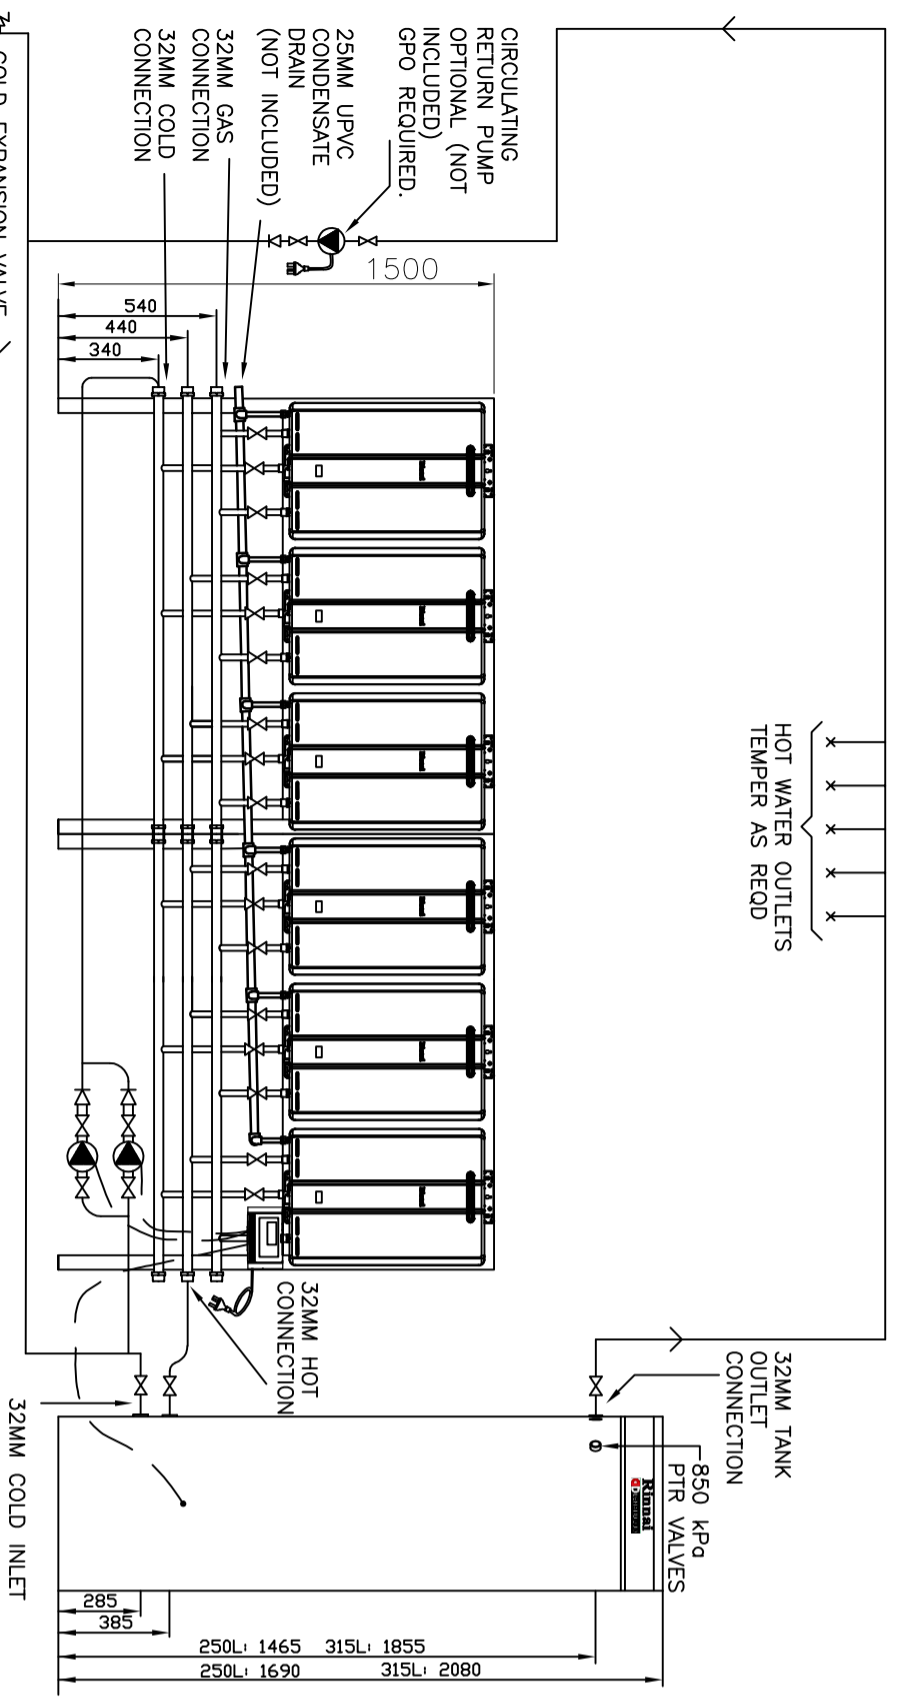

PLAN VIEW

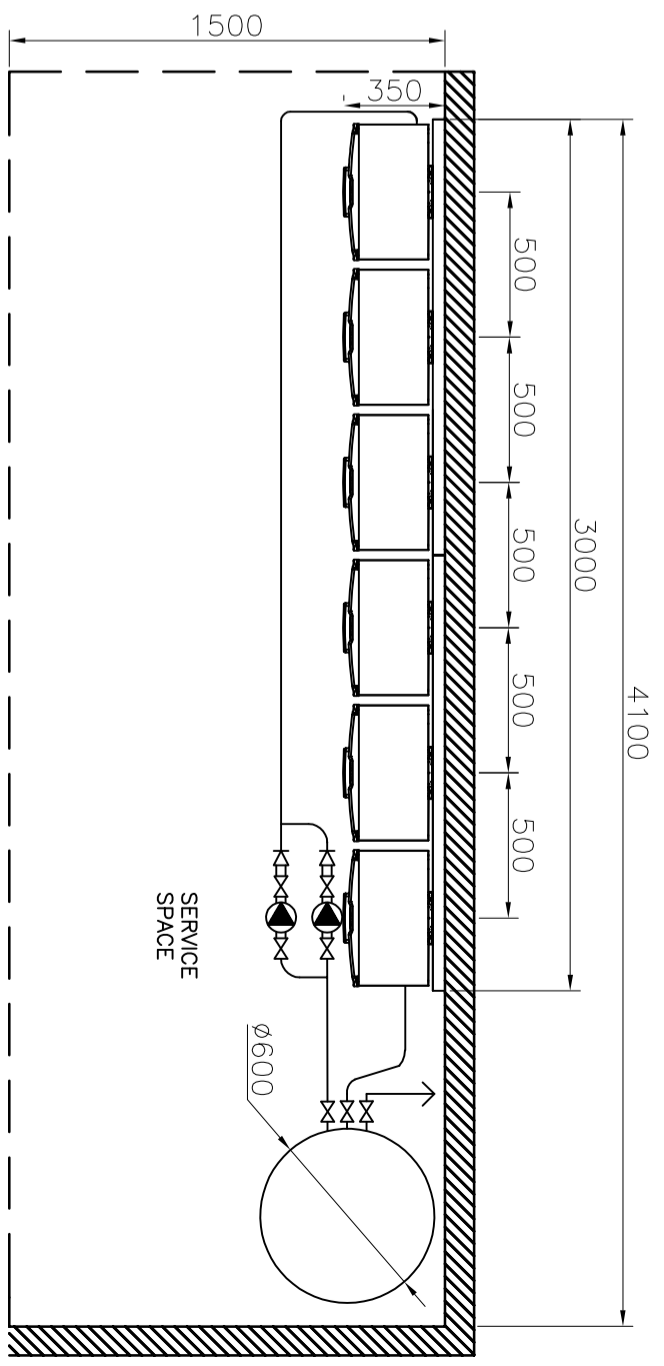

4 COLD EXPANSION VALVE
 3 PRESSURE LIMITING VALVE
 2 NON RETURN VALVE
 1 STRAINER
 X ISOLATION VALVE
 COLD WATER INLET

NOT INCLUDED

MATERIAL		DRAWN		RMP		Title	
TOLERANCE - UNLESS STATED		DATE		1/04/20		<h1>Rinnai Australia Pty Ltd</h1> <h2>DDF6210E-250/315N</h2>	
0. ±1.0		CHECKED		SVL			
0.0 ±0.5		APPROVED					
FINISH:		DIMENSIONS ARE IN MILLIMETERS AS 1:100		THIRD ANGLE PROJECTION		Weight	
		DO NOT SCALE DRAWING				SEE NOTES	
						Drawing Number(PART NO)	
						SK 0161	
						Revision	
						1	