

DRAWING CHANGES					
REV	ECON NO	DESCRIPTION	BY	CKD	DATE

TANK WEIGHT:
 DRY WEIGHT: 250L - 60kg
 315L - 72kg
 WET WEIGHT: 250L - 310kg
 315L - 385kg



SYSTEM WEIGHT:
 DRY WEIGHT: 250L - 308kg
 315L - 320kg
 WET WEIGHT: 250L - 558kg
 315L - 633kg

PRIMARY PUMP:
 DD6: 2xGRUNDFOS
 UPS32-100N

HD210 HEATERS:
 SYSTEM GAS LOAD: 1245MJ
 -NG 1.13-3.00 kPa
 -LPG 2.75-3.00 kPa

THERMOSTAT:
 FACTORY SET AT 65°
 (HIGHER TEMP AVAILABLE)

GENERAL NOTE:
 CONTROLLER REQUIRE:
 1 X EXTERNAL GPO (10AMP)
 HEATERS REQUIRE:
 1 X EXTERNAL GPO (10AMP)
 PER HEATER
 ** PLEASE NOTE **
 DO NOT RUN CONDENSATE DRAIN
 IN COPPER.
 UPVC PIPE IS RECOMMENDED.

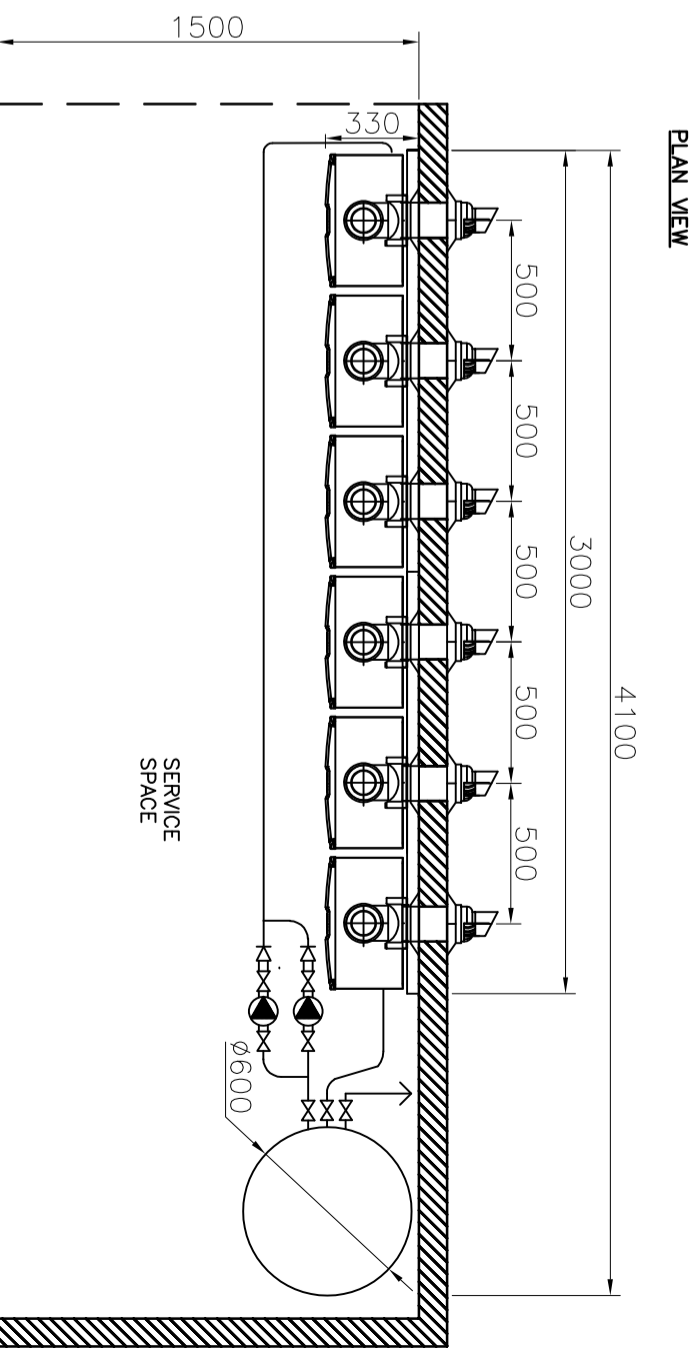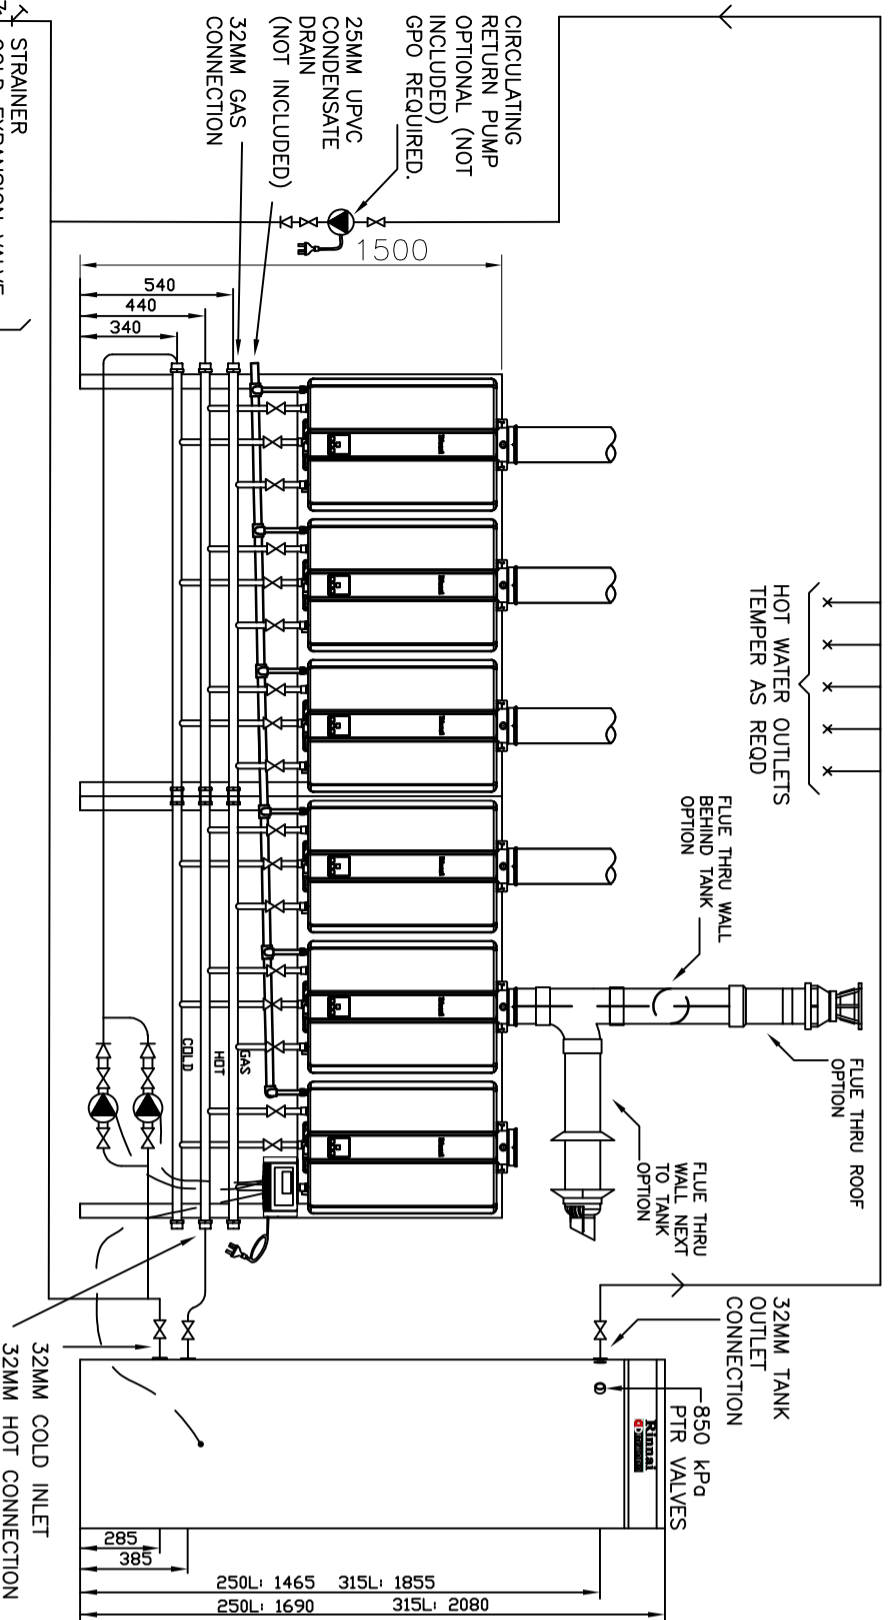

MATERIAL	TOLERANCE - UNLESS STATED	0. ±1.0	0.00 ±0.1
		0.0 ±0.5	Angular ±1°
FINISH:			

DRAWN	RMP	DATE	13/02/20
CHECKED	SVL	APPROVED	
DIMENSIONS ARE IN MILLIMETERS AS 1:100			
THIRD ANGLE PROJECTION			
DO NOT SCALE DRAWING			

Rinnai Australia Pty Ltd

Title: **DDF62101-250/315N**

Weight: **SEE NOTES**

Drawing Number(PART NO): **SK 0167**

Revision: **1**